



| | | |
|--|---------------------------|---------------------------|
| Boilers and Pressure Vessels Safety Program | Ref. No.: BPV13-02 | Rev. No.: 0 |
| SAFETY ORDER | Date: January 16, 2013 | Date: January 16, 2013 |

IN THE MATTER OF:
THE TECHNICAL STANDARDS AND SAFETY ACT, 2000, S.O. 2000, c. 16 (the "Act")
- and -
ONTARIO REGULATION 220/01 (Boilers and Pressure Vessels) made under the Act

Subject: Safety Order – Public notice on unauthorized repairs to pressure relief valves

Sent to: Boilers and Pressure Vessels Advisory Council, The Canadian Boiler & Machinery Underwriters Association (CB&MUA) and posted on the Technical Standards and Safety Authority website

The Director of Ontario Regulation 220/01 (Boilers and Pressure Vessels) pursuant to section 14 of the Technical Standards and Safety Act, 2000, hereby requires Owners, Users, Inspectors, Insurers and other persons responsible for the operation, use, maintenance, repair, inspection, etc. of boilers, pressure vessels and pressure piping to comply with this Safety Order as follows:

- a) Check the pressure relief valves installed on all pressure equipment regulated by O.Reg. 220/01 Boilers and Pressure Vessels, to determine if they are identified with nameplates and seals similar to those in Figure 1 attached, from Jaybell Control Products Ltd., Markham, Ontario.
- b) Pressure Relief Valves with nameplates and/or seals similar to those in Figure 1 attached, shall be removed from service immediately;
- c) Removed pressure relief valves shall be sent to an authorized pressure relief valve repair facility for re-setting and re-sealing, or shall be replaced with pressure relief valves that are properly sized for the equipment, certified and sealed;
- d) Any person finding a pressure relief valve with any of the marking(s) described in this Safety Order shall report the finding and location of the installation to TSSA Boilers and Pressure Vessels Safety Section immediately at Tel: 416-734-3368, Fax: 416-231-6183 or e-mail: agheorghe@tssa.org

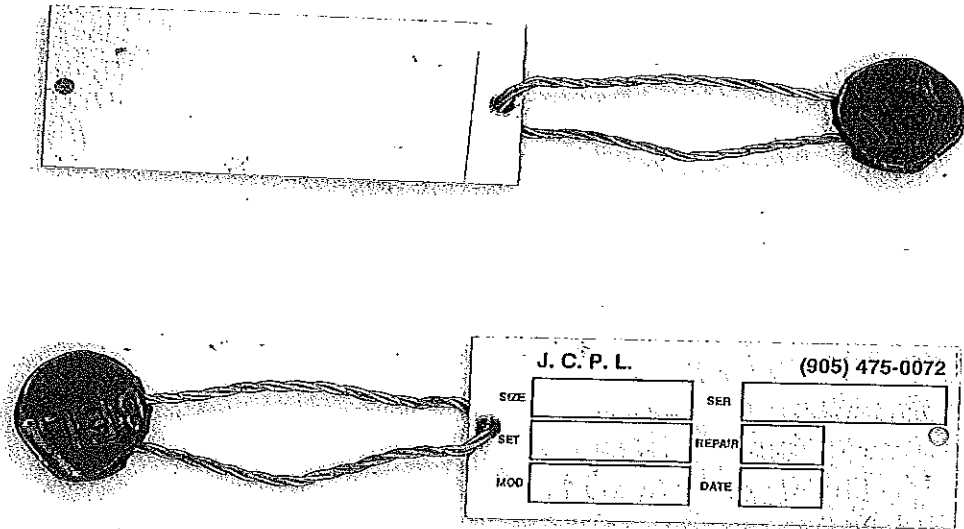


Figure 1
(Metal seal shows JAY on one side, BELL on opposite side)

Effective Date

This Safety Order is effective immediately.

Dated at Toronto this 15th day of January 2013

Mike Adams
 Statutory Director
 Ontario Regulation 220/01 (Boilers and Pressure Vessels), made under the *Technical Standards and Safety Act, 2000*