



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation


This Level 1 RSMP applies to:
 • a facility with a total propane storage capacity of 5,000 USWG or less; or
 • a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site.

Failure to fully complete this form may result in rejection.
Making a false statement may result in a fine or prosecution under the *Technical Standards and Safety Act*

Licence Number: 000076641902 **8229**

Check applicable type of propane operations.
 Cylinder Motor Fill Filling Plant Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.



SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

A Company Name: 1067541 Ontario Ltd. Ontario Corporation No., if applicable: _____
 Operator Name (if different from above): Amrik Ghuman
 Telephone No.: 9053725585 Fax No.: 9053720814 E-mail: aghuman@sympatico.ca

B Street No.: 1030 Street Name / 911 Number / Address, if applicable: Division Street
 Town / City or Township / County: Cobourg Province: Ontario Postal Code: K9A5Y5

Mailing address if different from above.
C Street No.: _____ Street Name / 911 Number / Address, if applicable: _____
 Town / City or Township / County: _____ Province: _____ Postal Code: _____

Information on Container Refill Centre or Filling Plant

D Location of facility.
 Street No.: 1030 Street Name / 911 Number / Address, if applicable: Division St. Nearest Major Intersection: Division st and Elgin St.
 Town / City or Township / County: Cobourg Province: Ontario Postal Code: K9A5Y5

Name of Licence Holder: 1067541 Ontario Ltd. O/A Cobourg Gas & Wash
 Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT): Amrik Ghuman ROT type: PTI 100-01
 Municipality (or municipalities if the facility or its hazard distance touches multiple borders): Town of Cobourg
 Hours of operation:

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Print name	Signature	Date (dd-mm-yyyy)
Name of Licence Holder: Amrik Ghuman		25-09-2011
Name of Senior Management person as defined in the Regulation holding the Record of Training: Amrik Ghuman		25-09-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)


Indicate the year the facility was established. 2008 Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment.

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank 1:	<u>250</u>	<u>95J83-4</u>
Tank 2:	_____	_____
Tank 3:	_____	_____

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 2000 USWG Portable: 139.2 USWG Mobile: N/A



Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Amrik Ghuman	Official Title President
Signature 	Telephone No. 905-372-5585
	Date (dd-mm-yyyy) 25-09-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Activity Information

Name of Propane Supplier(s) Carling Propane Inc.		For Office Use - Party No.	
Street No. 19752	Street Name / 911 Number / Address, if applicable Holland Landing Rd. Unit 201		
Town / City or Township / Country Holland Landing		Province Ontario	Postal Code L9N 0A1
Telephone No. 9059520146	Fax No. 9059520155	Contact Name David Sheppard	
E-mail			

Name of Propane Transporter. If same as above, please check box. <input checked="" type="checkbox"/>		[Redacted]	
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	
E-mail			

Off-site Cylinder and/or Mobile Storage N/A	Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable	
Town / City or Township / Country		Postal Code
Telephone No.	Fax No.	Contact Name

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Amrik Ghuman	Official Title President	
Signature 	Telephone No. 9053725585	Date (dd-mm-yyyy) 25-09-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

Regular Gas tank 1: 50000 Litres

Regular Gas tank 2: 45000 Litres

Supreme Gas tank: 23700 Litres

Diesel Tank: 23700 Litres

Description of fire and emergency equipment indicated on facility site map.

Fire extinguishers: 1 South West of canopy column, 1 North East of canopy column, 1 inside convenience store, 1 by propane dispenser and gas spill observer (located by the entrance door of convenience store), ISC valve interlock with door (valve closes when door closes).

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

Emergency stop button: shuts off the entire site including car wash and stops gas flow

Emergency stop button: specifically for propane tank

Fusible link on ISC Valve (main propane shut off valve)

Maintenance and testing schedule for fire protection controls and devices.

Fire extinguisher: testing schedule yearly

Site Emergency stop button is tested every month

Maintenance and testing under taken by Carling Propane according to Carling Propane's Maintenance Standards. Schedule for key equipment is - pump (3 months); ISC Valve (6 months); PRV's (every 2 years-visual; Replacement as per (Provincial Regulations)

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Amrik Ghuman	Official Title President
Signature 	Telephone No. 9053725585
	Date (dd-mm-yyyy) 25-09-2011



Technical Standards and Safety Authority
 www.tssa.org
 14th Floor - Centre Tower
 3300 Bloor Street West
 Toronto Ontario M8X 2X4
 Fax: 416.231.4903
 Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
 Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name Amrik Ghuman	For Office Use - Party No.	Name Amrik Ghuman	For Office Use - Party No.
Official Title President		Official Title President	
Telephone No. 9053725585	Fax No. 9053720814	Cell No. 9053963030	Fax No. 9053720814
E-mail aghuman@sympatico.ca		E-mail aghuman@sympatico.ca	
Role and responsibilities in emergency To take charge incase of emergency, train new staff of Emergency Action Plan (EAP)		Role and responsibilities in emergency To take charge incase of emergency, train new staff of Emergency Action Plan (EAP)	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name Sarbjit Ghuman	For Office Use - Party No.	Name Same as Above	For Office Use - Party No.
Official Title Partner		Official Title	
Telephone No. 9053725585	Fax No. 9053720814	Telephone No.	Fax No.
E-mail		E-mail	
Role and responsibilities in emergency To take charge incase of emergency, if Amrik Ghuman is not present, and to follow up with Amrik Ghuman A.S.A.P		Role and responsibilities in emergency	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name Aaron Blair	For Office Use - Party No.	Name David Sheppard	For Office Use - Party No.
Official Title Fire Prevention Officer	E-mail ablair@cobourg.ca	Official Title Supervisor	E-mail
Telephone No. 9053729789 ext 3300	Fax No. 9053720869	Telephone No. 9059520146	Fax No. 9059520155
Role and responsibilities in emergency Be familiar with Emergency Action Plan (EAP) and familiar with the facility and the Fire Inspection of facility and record findings		Role and responsibilities in emergency To take all action remedy any emergency, advise, and send in staff to render a safe facility and possible EAP procedure if required	
Fire Services Address 111 Elgin Street East, Cobourg Ontario, K9A 1A1		Propane Supplier Address	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name Michael D. Vilneff	For Office Use - Party No.	Name LORRAINE BRACE	
Official Title Deputy Chief	E-mail mvilneff@cobourg.ca	Official Title MUNICIPAL CLARK	
Telephone No. 9053729789	Fax No. 9053720869	Telephone No. 9053724301	Fax No. 9053721533
Role and responsibilities in emergency To perform fire inspections through out the year and report and finding to the owner, and responsible to make sure any corrections are completed.		E-mail	
Fire Services Address 111 Elgin Street east,		Municipality Name and Address 55 King Street west, Cobourg, Ontario	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Amrik Ghuman	Official Title President
Signature 	Telephone No. 9053725585
	Date (dd-mm-yyyy) 29/11/11



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

See- Emergency Action Plan (EAP) (attached)

Emergency stop push button which trips the dispenser pump and closes the solenoid valve upstream of the hose(s).

[Lined area for describing additional safety measures]

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Amrik Ghuman	Official Title President	
Signature 	Telephone No. 9053725585	Date (dd-mm-yyyy) 25-09-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mm-yyyy) 30-06-2011	Print Name of Training Provider: Carling Propane Inc.
	Print Name of Instructor: Doug Carpenter
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mm-yyyy)	Print Name of Training Provider: Amrik Ghuman (President)
	Print Name of Instructor: same as above
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mm-yyyy) 30-06-2011	Print Name of Training Provider: Propane Training Institute
	Print Name of Instructor: Doug Carpenter
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Amrik Ghuman	Official Title President
Signature 	Telephone No. 9053725585
	Date (dd-mm-yyyy) 25-09-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mm-yyyy) 30-06-2011	Print Name of Training Provider: Carling Propane Inc.
	Print Name of Instructor: Doug Carpenter
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mm-yyyy) 30-06-2011	Print Name of Training Provider: Amrik Ghuman (President)
	Print Name of Instructor: same as above
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mm-yyyy) 30-07-2011	Print Name of Training Provider: Propane Training Institute
	Print Name of Instructor: Doug Carpenter
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Amrik Ghuman	Official Title President
Signature 	Telephone No. 9053725585
	Date (dd-mm-yyyy) 25-09-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).
Amrik Ghuman or his partner (Sarbjit Ghuman) minor emergency call Carling Propane Inc or render if safe to do so by Amrik and notify supplier.

If it is a major emergency Amrik or Sarbjit or employee will call 911 immediately and shut down all power and internal safeties if safe to do.

If not safe to shut down safely, will evacuate and call 911.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).
Action and warnings will be taken by on duty ROT person(s) as per attached ERP placard. Only a few staff will be on duty when operating the propane system

The muster location will be in a safe area. Note a specific muster point is not advisable, since a propane plume can blow in any direction.

Note that the facility is in a wide open area allowing people to self evacuate.

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).
When the system is operational, ROT person will be on duty and be in the propane tank area. This person will be able to visually ascertain any abnormal/accident events and implement the appropriate emergency response actions. When the system is not in operation, the ISC valve (main isolation valve) is closed, and the propane system is unattended. Any accidents involving the propane tank during such times will require the intervention of random, nearby individuals or staff.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.
The propane tank is located in a wide open area that is easily accessible. The fire access route is off Division Street.

Describe how the licence holder will ensure continual flow of updated information to authorities.
The critical information required from the license holder is the fill level in the tank.
Fill level is relevant from a time-to-BLEVE perspective (a near empty tank will BLEVE sooner than a full tank if there is fire impingement on the tank)
This information will be provided to the authorities by agent- Amrik Singh Ghuman, time permitting and if available

How long will it take the facility liaison person to respond to the site.
Approximately 5 minutes after having received the emergency call. (Owners/Employees always at site during operating hours).

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Amrik Ghuman	Official Title President	
Signature 	Telephone No. 905-372-5585	Date (dd-mm-yyyy) 25-09-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)	<u>14.87 meters</u>	
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)	<u>8.97 metres</u>	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Amrik Ghuman	Official Title President	
Signature 	Telephone No. 905-372-5585	Date (dd-mm-yyyy) 25-09-2011



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes No

If not, please explain (e.g., no fire services).

Will fax pg. 11 to TSSA once completed by the Fire department

Fire services comments, if any:

see attached letter

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by: _____

(dd-mm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Local Fire Services Name	Signature	Date (dd-mm-yyyy)
<i>Aaron Blair</i>	<i>[Signature]</i>	<i>21 10 2011</i>

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title
Amrik Ghuman	President
Signature	Date (dd-mm-yyyy)
<i>[Signature]</i>	25-09-2011
Telephone No.	
905-372-5585	



Technical
Standards and
Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.6772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below.

Required Mapping Information from Updated Site Plan

Date Map Prepared (dd-mm-yyyy) 29/11/11	Capacity of single largest propane storage vessel (USWG) 2000 USWG
Tank setback coordinates. Indicate placement on the map.	
Front: 14. m -	Right side property line: 92. m -
Rear: 8. m -	Left side property line: 76. m -
GPS coordinates of single largest vessel: 43° 58' 50" N, 76° 10' 29" W	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Amrik Ghuman	Official Title President
Signature 	Telephone No. 905-372-5585
	Date (dd-mm-yyyy) 29/11/11



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)
Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

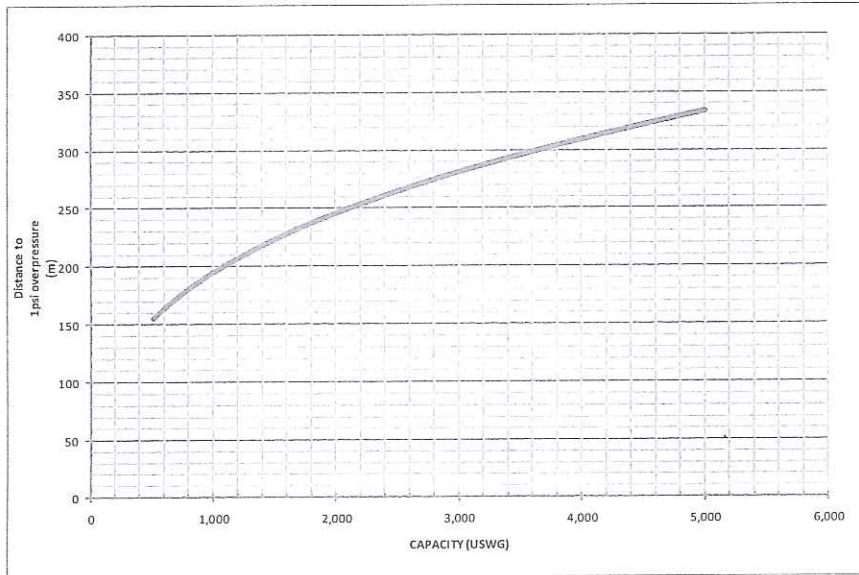

SR 608366



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: <u>N/A</u> Address: _____ City: _____ Province _____ Postal Code _____	X				<u>0</u> m
Residential building units specifically permanent single family dwellings, condominiums, and apartments [REDACTED]			X		<u>122</u> m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: <u>Subway (RESTAURANTS)</u> Address: <u>1030 DIVISION ST</u> City: <u>COBOURG</u> Province <u>ON</u> Postal Code <u>K9A5Y5</u>			X		<u>76</u> m
Commercial building units - continuous occupancy specifically hotels, campgrounds, and resorts. Name: <u>MOTEL 401 (MOTEL)</u> Address: <u>1144 DIVISION ST</u> City: <u>COBOURG</u> Province <u>ON</u> Postal Code <u>K9A5Y9</u>		X			<u>92</u> m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: <u>N/A</u> Address: _____ City: _____ Province _____ Postal Code _____	X				<u>0</u> m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: <u>N/A</u> Address: _____ City: _____ Province _____ Postal Code _____	X				<u>0</u> m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Amrik Ghuman	Official Title President	
Signature <i>Amrik Ghuman</i>	Telephone No. 905-372-5585	Date (dd-mm-yyyy) 29/4/11



Technical Standards and Safety Authority
www.tssa.org

14th Floor - Centre Tower
3300 Bloor Street West
Toronto Ontario M8X 2X4
Fax: 416.231.4903
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

WORKSHEET

Portable Storage Additional Information Worksheet


Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9	0	
# 100	29.5	0	
# 40	11.75	0	
# 33.3	9.62	0	
# 30	8.8	0	
# 20	5.8	24	139.2
# 10	2.9	0	
# 5	1.5	0	
Total Cylinder Capacity 139.2			

Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume in USWG
N/A	N/A	N/A
Total Tank Capacity N/A		

Total Cylinder Capacity	139.2
Total Tank Capacity	2000 USWG Dispenser
Total Portable Capacity (Total Cylinder Capacity + Total Tank Capacity)	139.2

- Fire Extinguisher
- Emergency Shut-off (ESO)
- + First Aid Kit
- MPS Main Power Shut off
- Ⓜ Designated Meeting Area
- PC Reproove Cage
- FH Fire Hydrant
- UST UNDER GROUND GASOLINE STORAGE

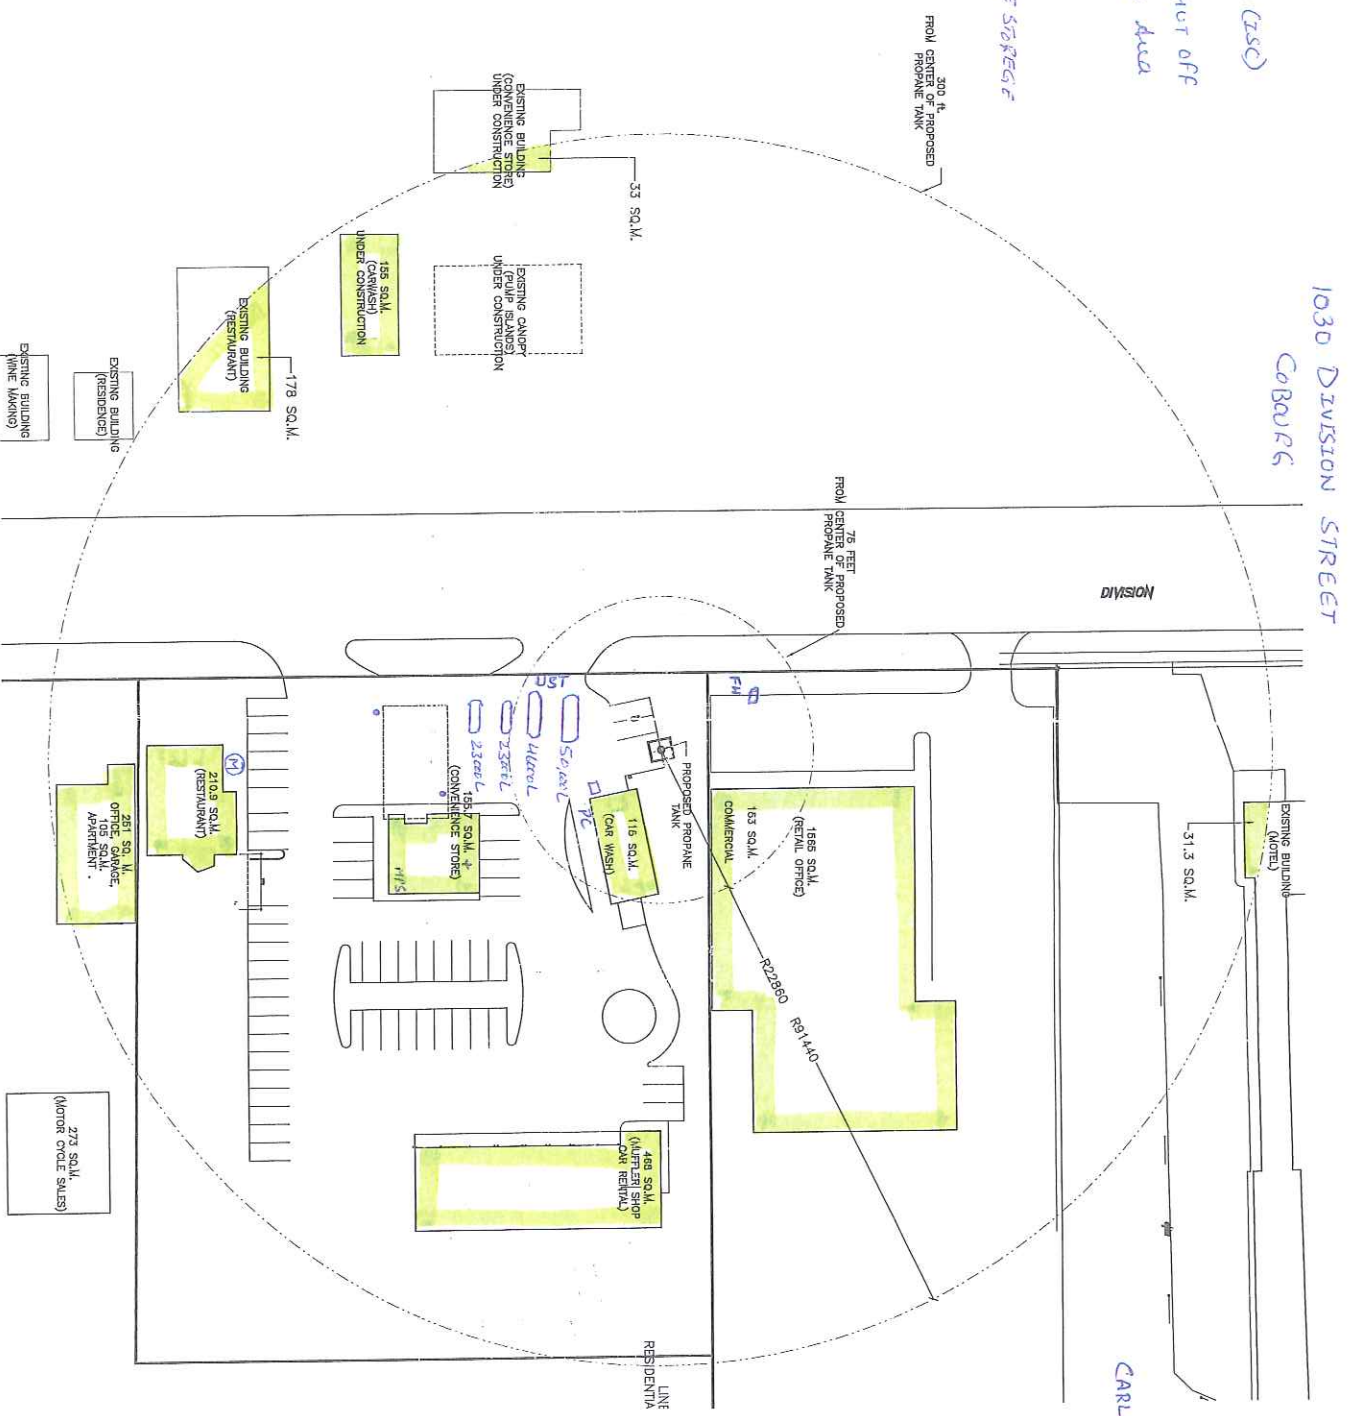

1030 DIVISION STREET
COBURG

EMERGENCY NUMBER
Ambulance 911
Police 911
Fire 911

CARLING PROPANE 1-866-346-8994

Legend

- Sanitary Manhole
- Storm Manhole
- propane tank location
- Hydrant
- Water Valve

SE BAK FRONT 1/4M
 SETBACK REAR = 8M
 RIGHTSIDE = 9.2M
 LEFTSIDE = 7.6M

GPS 43° 55' 50" N, 78° 10' 29" W

Elgin Street West

Elgin Street East

Division Street

Veronica Street

Paterson Street

Highway 45

Densmore Road

Birchwood Trail


Propane Tank



TOWN OF COBURG
 55 King St W, Cobourg ON K9A 2M2
 Lorraine Brace, Municipal Clerk
 Nov. 29, 2011




246m radius from propane tank @ 1030 Division St

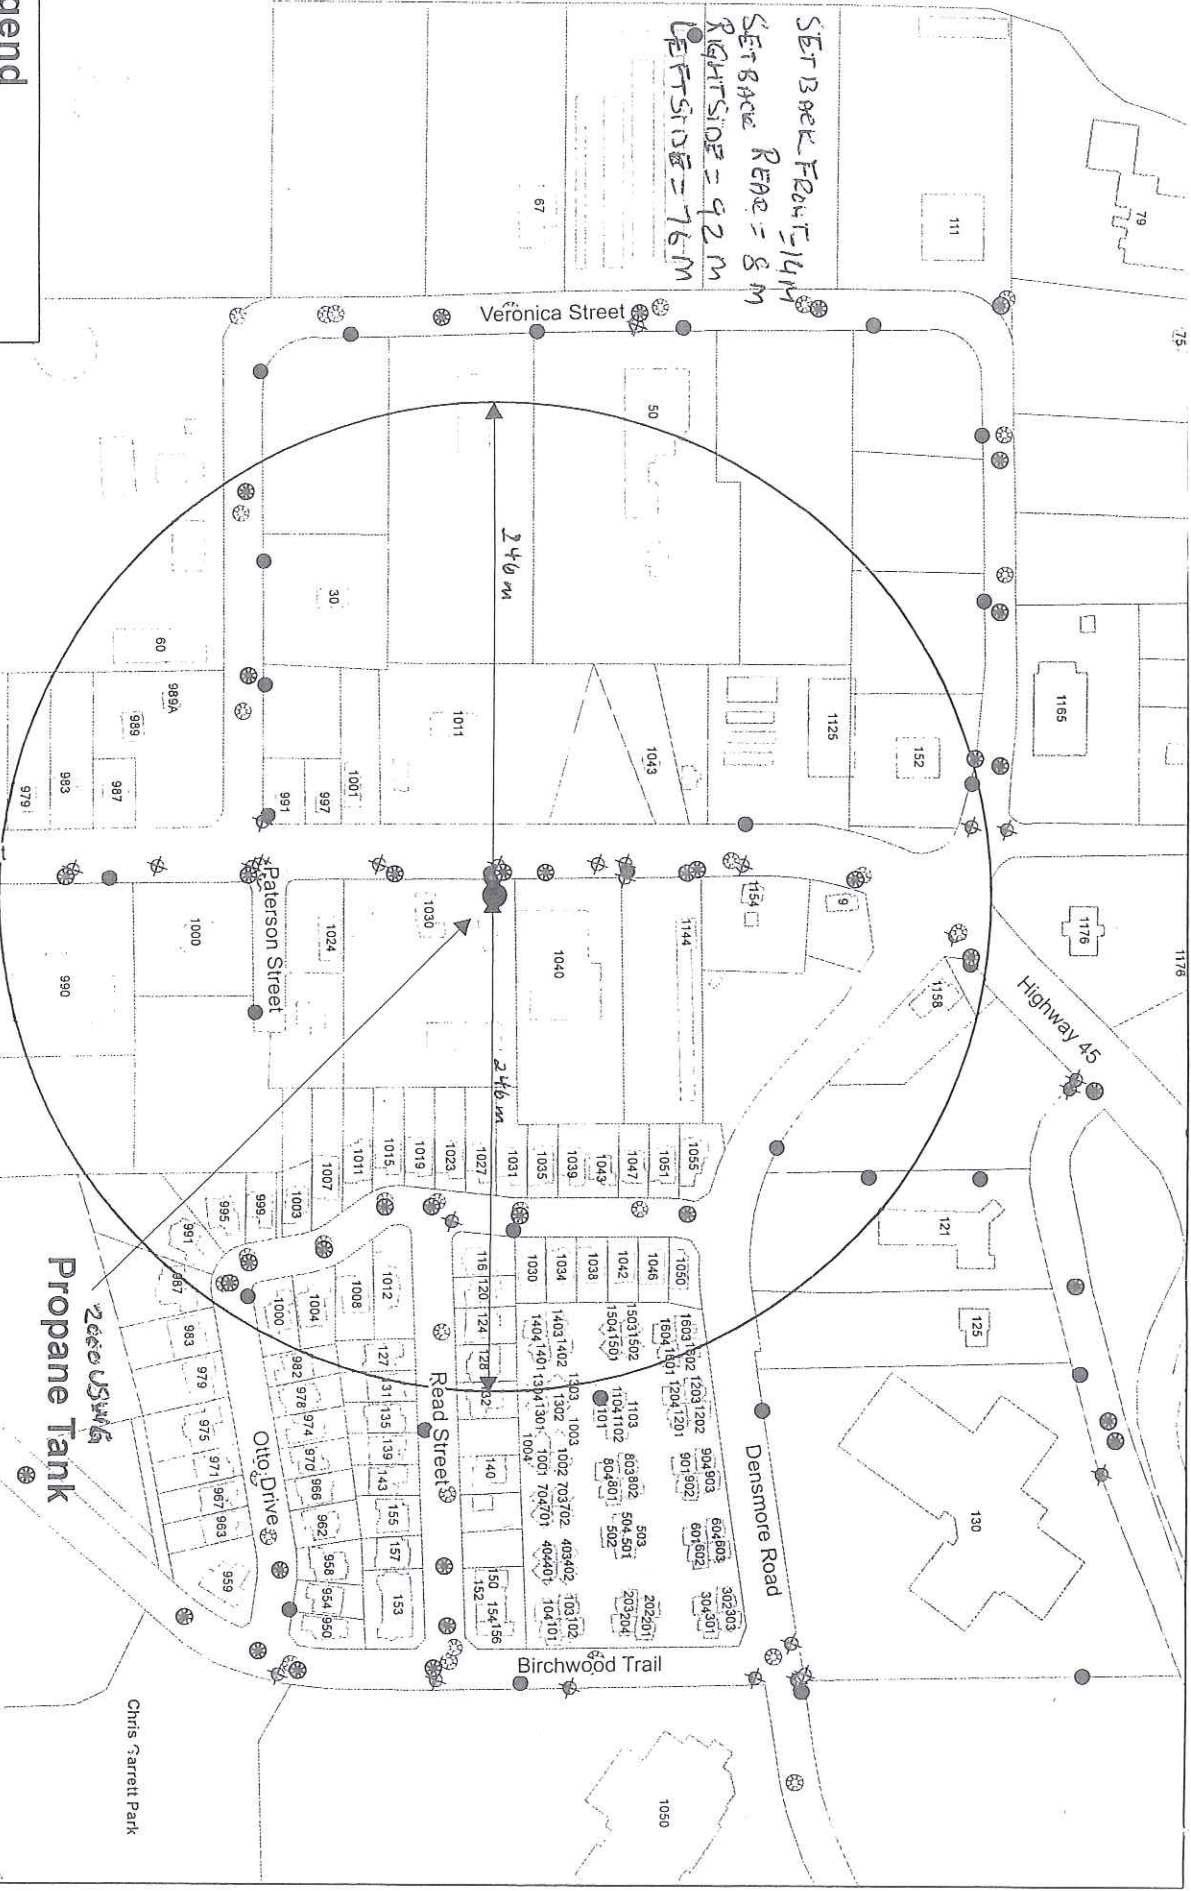





TOWN OF COBOURG

246m Buffer of 1030 Division St




100 50 0 100 Metres

Projection: NAD83 UTM Zone 17N
© Town of Cobourg, 2011.

Legend

- Sanitary Manhole
- ⊙ Storm Manhole
- propane tank location
- Hydrant
- ⊕ Water Valve

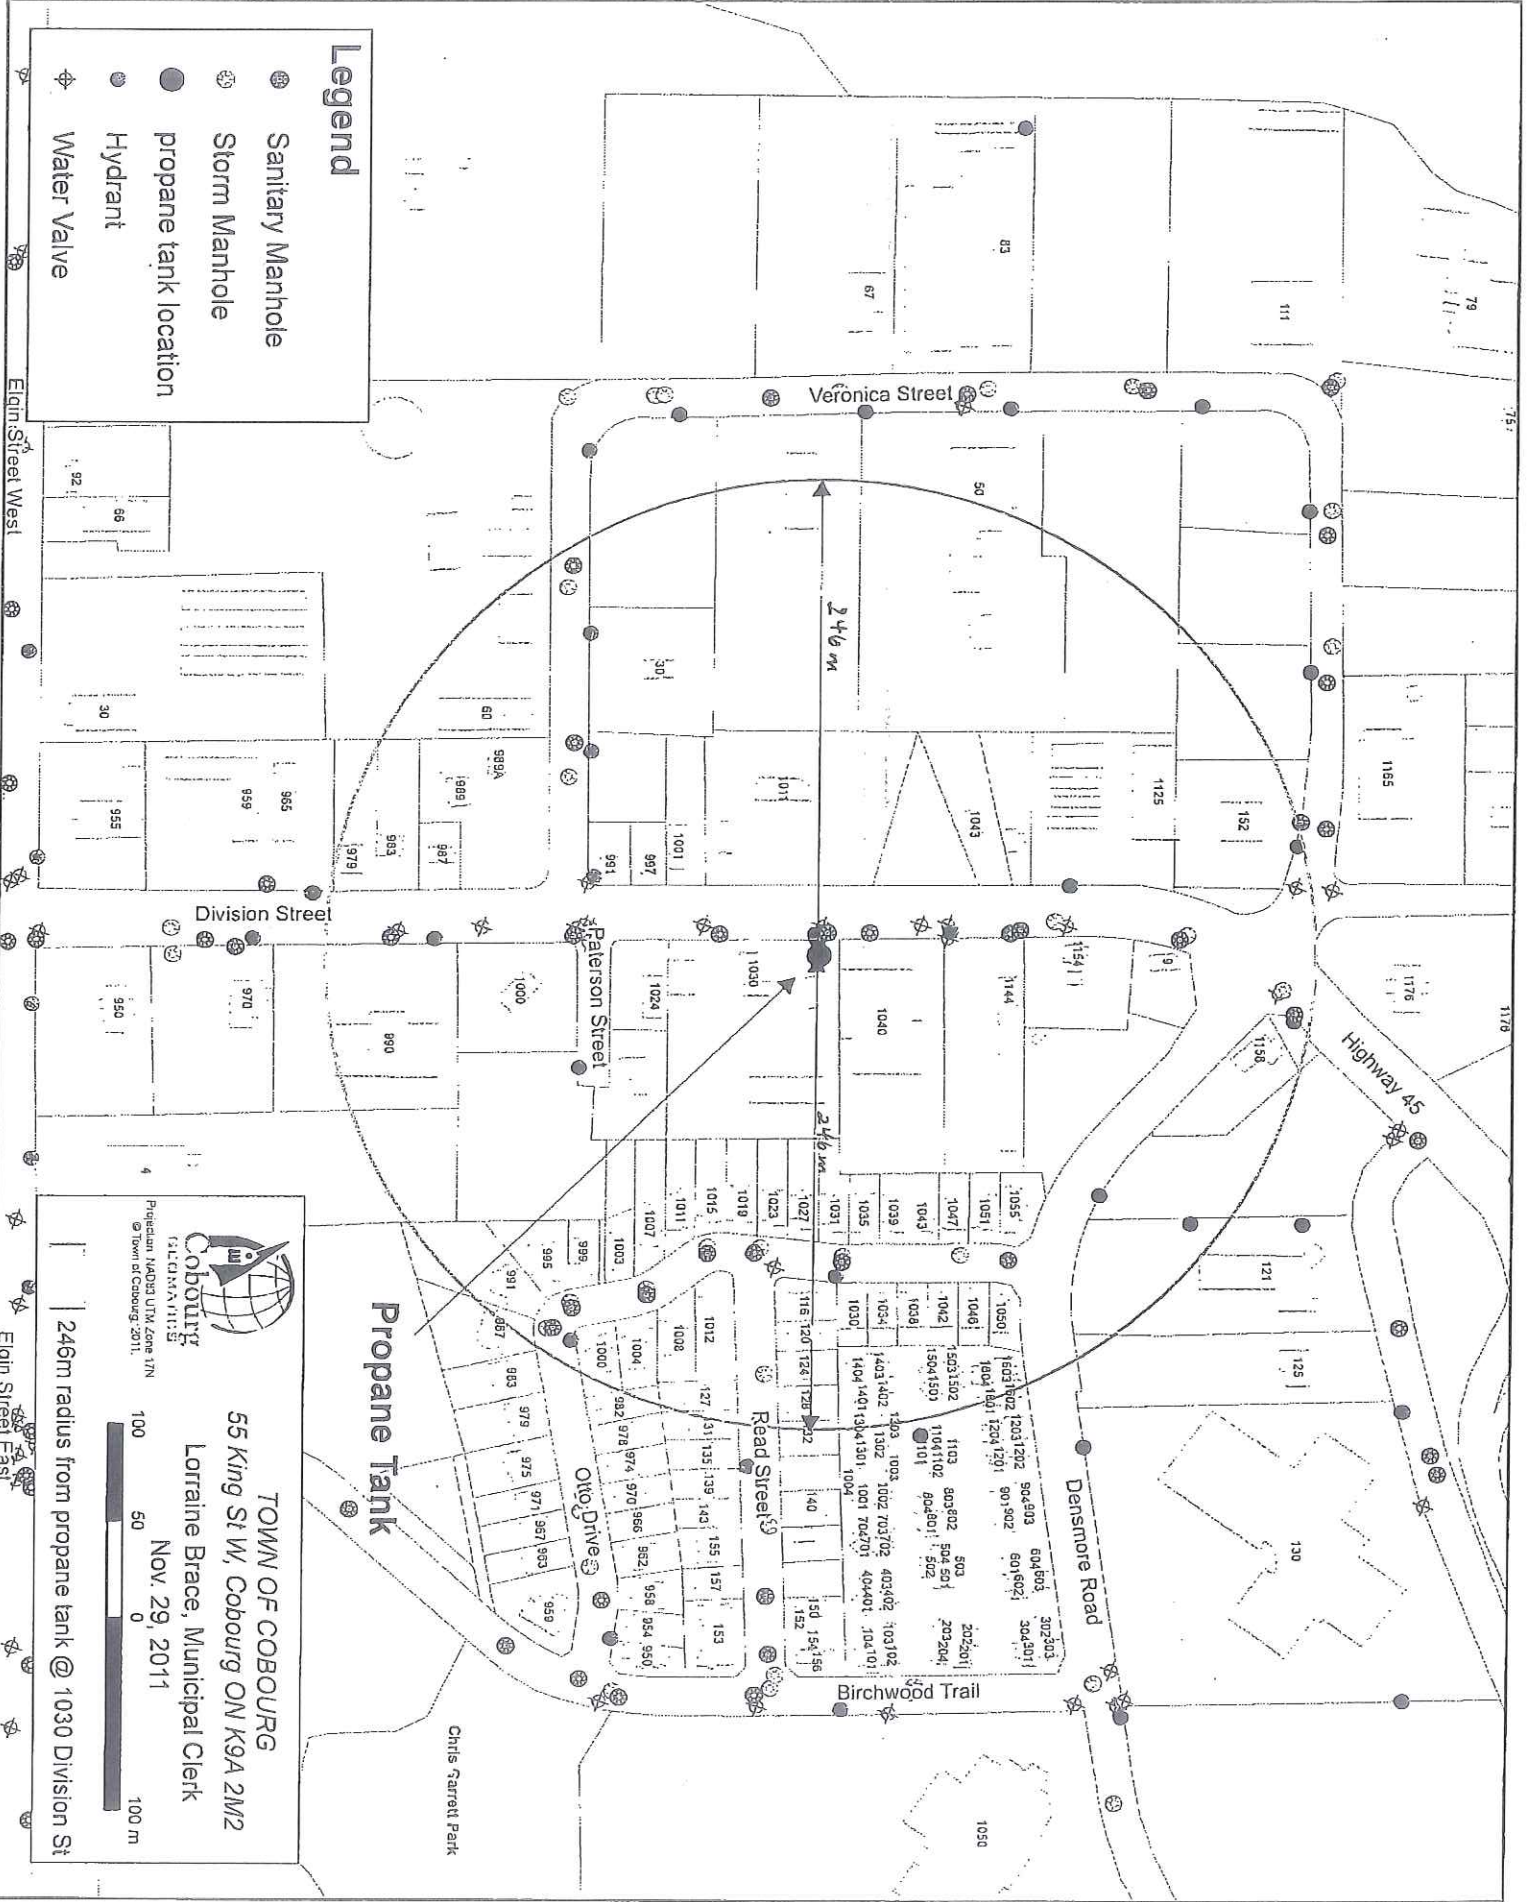

Propane Tank

246m

246m



TOWN OF COBURG
55 King St W, Cobourg ON K9A 2M2
Lorraine Brace, Municipal Clerk
NOV. 29, 2011



246m radius from propane tank @ 1030 Division St

Projection: NAD83 UTM, Zone 17N
Datum: IGSN85
Datum ID: Cobourg_2011