




Technical Standards and Safety Authority  
 www.tssa.org  
 14th Floor - Centre Tower  
 3300 Bloor Street West  
 Toronto Ontario M9X 2X4  
 Fax: 416.231.4903  
 Customer Service: 1.877.602.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
 Propane Storage and Handling Regulation

This Level 1 RSMP applies to:
 

- a facility with a total propane storage capacity of 1000 L or more
- a facility with a fixed propane storage capacity of 1000 L or more
- USWG of portable propane storage capacity

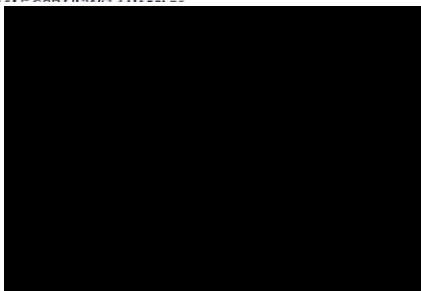

Failure to fully complete this form may result in rejection.  
 Making a false statement may result in a fine or prosecution  
 under the *Technical Standards and Safety Act*

Licence Number 0076576921-C

Check applicable type of propane operations.

Cylinder     Motor Fill     Filling Plant     Card/Keylock

Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.

**SECTION A: GENERAL INFORMATION**

The undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

Company Name Homepayne Service Center Inc. Ontario Corporation No., if applicable

Operator Name (if different from above)  
Same

Telephone No. 807-868-2638 Fax No. 807-868-2179 E-mail hsc2001@live.com

Street No. 2001 Street Name / 911 Number / Address, if applicable HWY 631 North P.O Box 130

Town / City or Township / County Homepayne Province On Postal Code P0M 1Z0

Mailing address if different from above.

Street No. same Street Name / 911 Number / Address, if applicable

Town / City or Township / County Province Postal Code

**Information on Container Refill Centre or Filling Plant**

Location of facility.

Street No. 2001 Street Name / 911 Number / Address, if applicable HWY 631 North Nearest Major Intersection HWY 631 & Becker Road

Town / City or Township / County Province Postal Code

Homepayne On P0M 1Z0

Name of Licence holder  
Homepayne Service Center Inc.

Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). ROT type  
Steve Renaud PTI 100-1 Cert. # 62828 (PP0-3)

Municipality (or municipalities if the facility or its hazard distance touches multiple borders)  
Corporation of the Township of Homepayne

Hours of operation.

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.  
 Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Printname	Signature	Date (dd-mm-yyyy)
Name of Licence Holder <u>Homepayne Service Center Inc.</u>		<u>24/10/2012</u>
Name of Senior Management person as defined in the Regulation holding the Record of Training <u>Steve Renaud</u>		



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION A: GENERAL INFORMATION (cont'd)**


Indicate the year the facility was established. 1980  
Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment. 2003

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank 1:	250	20J82-22
Tank 2:		
Tank 3:		

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: 2000      Portable: 1561      Mobile: 0



**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Steve Renaud	Official Title President
Signature 	Telephone No. 807-868-2638
	Date (dd-mm-yyyy) 24/01/2012



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

Level 1 Risk and Safety Management Plan (RSMP)  
Technical Standards and Safety Act  
Propane Storage and Handling Regulation

**SECTION A: GENERAL INFORMATION (cont'd)**  
Activity Information

Name of Propane Supplier(s) Superior Propane - Regional Operation Centre			
Street No. 251	Street Name / 911 Number / Address, if applicable Woodland Road East Unit 217		
Town / City or Township / Country Guelph		Province On	Postal Code N1H 8J1
Telephone No. 877-873-7467	Fax No. 519-836-7766	Contact Name Bruce Graham	
E-mail grahamb@superiorpropane.com			

Name of Propane Transporter. If same as above, please check box. <input type="checkbox"/>			
Superior Propane			
Street No. 2475	Street Name / 911 Number / Address, if applicable Maney Drive		
Town / City or Township / Country Sudbury		Province On	Postal Code P3A 4R7
Telephone No. 705-877-8431	Fax No. 519-836-7766	Contact Name Paul Bastien	
E-mail bastienp@superiorpropane.com			

Off-site Cylinder and/or Mobile Storage None	Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable	
Town / City or Township / Country		Province
Telephone No.		Contact Name

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Steve Renaud	Official Title President
Signature 	Telephone No. 507-868-2638
Date (dd-mm-yyyy) 24/01/2012	





Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN**

The licence holder will complete Section B: In consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

Gasoline 34,500 litres - under ground tank

Diesel 12,000 litres - under ground tank

Motor oil 1000 litres (Shop & Storage Trailer)

Description of fire and emergency equipment indicated on facility site map.

ABC Fire extinguisher

1- 2 - ABC fire extinguisher located at the Cylinder Dock

2- 10 - ABC fire extinguisher located throughout the shop

3- 1 - ABC fire extinguisher located store counter

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

1- Fusible link on ISC - Isolation valve between the tank and the downstream propane dispensing equipment.

3. Power supply breaker inside the main building. This cuts all power to the propane system - shuts down pump; closes solenoid valve.

Maintenance and testing schedule for fire protection controls and devices.

Maintenance and testing is undertaken by Superior Propane according to Superior's Maintenance Standards. Schedule for key equipment is:

1- Pumps - (pumps every 3 months; pump motor: check belts monthly; grease pump every 6 months).

2- ISC valve (test for closure every 6 months).

3- Storage tank Relief Valves - Inspected every 2 years; replacement schedule as per provincial regulations.

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Steve Renaud	Official Title President
Signature 	Telephone No. 807-868-2638
	Date (dd-mm-yyyy) 24/01/2012



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

1. Contacts for Emergency Response

<b>1. Facility Contact Personnel - Key Contact</b>		<b>5. Facility 24-Hour Contact Person</b>	
Name Steve Renaud		Name Steve Renaud	
Official Title President		Official Title President	
Telephone No. 807-868-2638	Fax No. 807-868-2179	Cell No. 807-868-2638	Fax No. 807-868-2179
E-mail hsc2001@live.com		E-mail hsc2001@live.com	
Role and responsibilities in emergency Co-ordinate site response plan (ERP)		Role and responsibilities in emergency Co-ordinate site response plan (ERP)	
<b>2. Facility Contact Personnel - Alternate Contact</b>		<b>6. Name of Facility Manager</b>	
Name Carole Gilbert		Name Shawn Milne	
Official Title Manager		Official Title Asset Manager	
Telephone No. 807-868-9932	Fax No. None	Telephone No. 807-868-3217	Fax No.
E-mail hsc2001@live.com		E-mail lesleydawn@vianet.ca	
Role and responsibilities in emergency Co-ordinate site response plan (ERP)		Role and responsibilities in emergency Co-ordinate site response plan (ERP)	
<b>3. Local Fire Services - Key Contact</b>		<b>7. Propane Supplier Key Contact Person</b>	
Name Dennis Mackie	For Office Use - Party No.	Name Superior Propane Hot Line	For Office Use - Party No.
Official Title Fire Chief		Official Title	
Telephone No. 807-868-2212	Fax No. 807-868-3179	Telephone No. 877-873-7467	Fax No. N/A
E-mail mackie.hpayne@bellnet.ca		E-mail n/a	
Role and responsibilities in emergency Coordinate emergency response / ordnate / advise on Fire Service Response. Liaise with police services.		Role and responsibilities in emergency Identify and dispatch Superior Propane and or LPGERC emergency response personal as required	
<b>4. Local Fire Services - Alternate Contact</b>		<b>8. Municipal Contact</b>	
Name John Coture	For Office Use - Party No.	Name Susan Smith	
Official Title Fire Prevention Officer		Official Title Township Clerk	
Telephone No. 807-868-2212	Fax No. 807-868-3179	Telephone No. 807-868-2020	Fax No. 807-868-2787
E-mail N/A		E-mail smith.hpayne@bellnet.ca	
Role and responsibilities in emergency Coordinate emergency response when key contact is not available and Liaise with police services.		Municipality Corporation of the Township of Homepayne	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Steve Renaud	Official Title President
Signature 	Telephone No. 807-868-2638
	Date (dd-mm-yyyy) 24/01/2012





Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

None

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Steve Renaud	Official Title President	Date (dd-mm-yyyy) 24/01/2012
Signature 	Telephone No. 807-868-2639	

FS 09195 (11/10) Page 6 of 15



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

**3. Record of Emergency Training Provided - For most recent 12-month period.**

**Training on Emergency Response Plan and Procedures provided to facility key contacts.**

Training Date (dd-mm-yyyy) None	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

**Training on the facility's Emergency Management Procedures provided to staff.**

Training Date (dd-mm-yyyy) None	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

**On-site specific training provided to certificate holders / persons with Records of Training.**

Training Date (dd-mm-yyyy) 01-03-2011	Print Name of Training Provider: Superior Propane	Please Note - a ROT is valid for 3 years
	Print Name of Instructor: Fuzzy Foisy	
Training Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	
Training Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Steve Renaud	Official Title President
Signature 	Telephone No. 807-868-2638
	Date (dd-mm-yyyy) 04/01/2012





Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

**4. Emergency Training Plan for Coming Year**

**Training on Emergency Response Plan and Procedures provided to facility key contacts:**

Target Date (dd-mm-yyyy) Q1-2012	Print Name of Training Provider: Superior Propane or Alternate	Please note: Canadian Propane Gas Association
	Print Name of Instructor: to be arranged	is currently developed the PTI 911-02 course
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	content and if and its provider is available to
	Print Name of Instructor:	taught in the first quarter of 2012.
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	

**Training on the facility's Emergency Management Procedures provided to staff:**

Target Date (dd-mm-yyyy) Q1-2012	Print Name of Training Provider: Key Contact to train staff
	Print Name of Instructor: to be arranged
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

**On-site specific training provided to certificate holders / persons with Records of Training:**

Target Date (dd-mm-yyyy) Q2-2012	Print Name of Training Provider: Superior Propane	Please Note - a ROT is valid for 3 years
	Print Name of Instructor: Fuzzy Foisy	Owner to call if training is required in 2012
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	
Target Date (dd-mm-yyyy)	Print Name of Training Provider:	
	Print Name of Instructor:	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Steve Renaud	Official Title President
Signature 	Telephone No. 807-868-2638
	Date (dd-mm-yyyy) 04/01/2012





Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
**Technical Standards and Safety Act**  
**Propane Storage and Handling Regulation**

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

**5. Emergency Response Communications Plan**

**Warnings and Actions**

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).  
The operator or Alternate will contact emergency services by calling 911 and will provide warnings outlined in the attached: "Propane Emergency Response Procedures" placard (to be posted on site and part of the employee training). If it is safe to do so this could involve advising neighbors to evacuate. The owner/operator may also contact Superior Propane via the emergency number identified in the ERP.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).

The owner/operator or alternate should first follow the actions in the ERP provided herein. Stage evacuation, if the release of propane cannot be stopped by cutting electrical power may be required. Note a specific muster point is not advisable, since a propane plume can blow in any direction.

Actions will be taken by an on duty ROT person(s)

**Communication with Emergency Response Authorities**

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).

When the system is operational, a ROT person will be on duty and be in the propane tank area. This person will be able to visually ascertain any abnormal/accident event and implement the appropriate emergency response actions. When the system is not in operation, the ISC valve (main isolation valve) is closed, and the propane system is unattended. Any accident involving the propane tank during such times will require the intervention of random, nearby individuals.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.

The propane tank system is located in a wide open area that is easily accessible.

The fire access routes are identified in the attached site plan.

Describe how the licence holder will ensure continual flow of updated information to authorities.

The critical information required from the license holder is (a) how to shut the system down and (b) the fill level in the tank (if known)

Fill level is relevant from a time-to-BLEVE perspective (a near empty tank will BLEVE sooner than a full tank if there is a fire impingement on the tank).

This information will be provided to the authorities by site President Steve Renaud or alternate.

How long will it take the facility liaison person to respond to the site.

In case of an emergency it would take 5 minutes to reach the facility

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Steve Renaud	Official Title President
Signature 	Telephone No. 807-868-2638
Date (dd-mm-yyyy) 24/01/2012	



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

**6. Building and Site Security and Procedures**

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

**7. Water Supply**

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)	70 m (fire hydrant)	
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? ( distance in metres only)	N/A	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Steve Renaud	Official Title President	
Signature 	Telephone No. 807-868-2638	Date (dd-mm-yyyy) 24/01/2012





Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.6772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)**

The licence holder will complete Section B in consultation with the local Fire Services.

**8. Licence holder and local Fire Services Review**

**To be completed by the Local Fire Services**

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan? Yes  No

If not, please explain (e.g., no fire services).

Fire services comments, if any:

**To be completed by the Licence Holder**

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by: \_\_\_\_\_ (dd-mm-yyyy)

**LOCAL FIRE SERVICES**

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Print name	Signature	Date (dd-mm-yyyy)
Local Fire Services Name		

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Steve Renaud	Official Title President	
Signature 	Telephone No. 807-868-2638	Date (dd-mm-yyyy) 24/01/2012



Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.692.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
**Technical Standards and Safety Act**  
**Propane Storage and Handling Regulation**

**SECTION C: SUBMISSIONS**

Applicant must include a Facility Site Plan and Map of Surrounding Area

**Facility Site Plan.**

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

**Map of Surrounding Area.**

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below.

**Required Mapping Information from Updated Site Plan**

Date Map Prepared (dd-mm-yyyy) 007-01-2012	Capacity of single largest propane storage vessel (USWG) 2000 USWG
Tank setback coordinates. Indicate placement on the map.	
Front: 8.6 m	Right side property line: 8.6 m
Rear: 11.3 m	Left side property line: 53.8
GPS coordinates of single largest vessel: 49.212103 -84.765916 (estimate)	

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Name of person completing this form (please print) Steve Renaud	Official Title President
Signature 	Telephone No. 807-868-2638
	Date (dd-mm-yyyy) 24/01/2012





Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X 2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS (cont'd)**  
Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

**Formula:**  $D = 16.94 \times (1.524 \times C)^{1/3}$   
 D = Distance to overpressure of 1 psi (meters)  
 C = Tank Total Capacity in USWG

**Parameters:** Density of Propane is 0.5033 kg per litre @ 15 C  
 Assume all vessels are 80% full  
 1 gallon [US, liquid] = 0.003785411784 cubic meter  
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

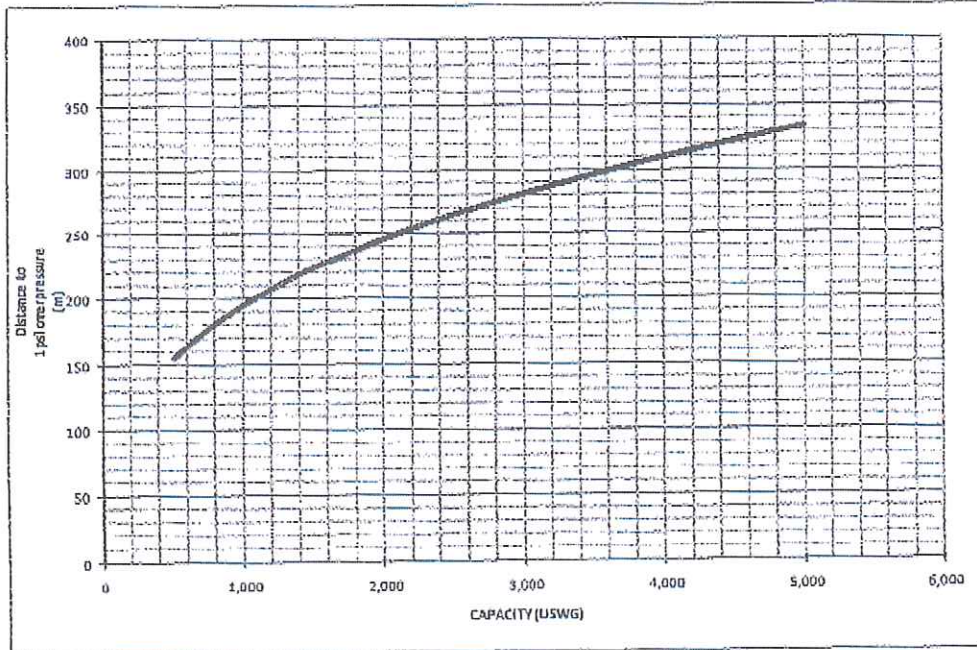

**Declaration:** I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) Steve Renaud	Official Title President
Signature 	Telephone No. 307-868-2638
	Date (dd-mm-yyyy) 24/01/2012



Technical Standards and Safety Authority  
 345 Carlingview Drive  
 Toronto, Ontario M9W 6N9  
 Fax: 416.231.4078  
 Customer Service: 1.877.682.8772  
 www.tssa.org

**Application for Renewal of  
 Level 1 Propane Licence**  
**Technical Standards and Safety Act**  
 Propane Storage and Handling Regulation

**SUBMISSIONS (cont'd)**

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

**Table 2: Buildings and Features**

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	* Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: <u>Hornepeyne Service Center Inc</u> Address: <u>2001 Hwy 631 N</u> City: <u>Hornepeyne</u> Province <u>On</u> Postal Code <u>R0M1Z0</u>		X			<u>12</u> m
Residential building units specifically permanent single family dwellings, condominiums, and apartments. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____					_____ m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____					_____ m
Commercial building units - continuous occupancy specifically hotels, campgrounds, and resorts. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____					_____ m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____					_____ m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: _____ Address: _____ City: _____ Province _____ Postal Code _____					_____ m

\* For multi-unit buildings, count each unit as "1".

You are required by law to notify TSSA of any change of information contained in the Risk and Safety Management Plan within 15 days.

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**

Print name of person completing this form. <u>Steve Benard</u>	Official Title <u>President</u>
Signature <u>[Signature]</u>	Telephone No. <u>807 868-2638</u> Date (dd-mmm-yyyy) <u>17/09/18</u>





Technical Standards and Safety Authority  
www.tssa.org

14th Floor - Centre Tower  
3300 Bloor Street West  
Toronto Ontario M8X2X4  
Fax: 416.231.4903  
Customer Service: 1.877.682.8772

**Level 1 Risk and Safety Management Plan (RSMP)**  
*Technical Standards and Safety Act*  
Propane Storage and Handling Regulation

**SECTION C: SUBMISSIONS (cont'd)**  
Applicant must include a Facility Site Plan and Map of Surrounding Area

Portable Storage Additional Information Sheet

Cylinder Size	Capacity in USWG	Quantity	Total Volume In USWG
# 420	123.9	0	0
# 100	29.5	40	1180
# 40	11.75	0	0
# 33.3	9.62	0	0
# 30	8.8	40	352 (20 x 60lb cylinders)
# 20	5.8	5	29
# 10	2.9	0	0
# 5	1.5	0	0
<b>Total Cylinder Capacity</b>			1561

Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume In USWG
0	0	0
<b>Total Tank Capacity</b>		0


<b>Total Cylinder Capacity</b>	1561
<b>Total Tank Capacity</b>	2000 USWG Propane refill tank
<b>Total Portable Capacity</b>	1561

**Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.**


Name of person completing this form (please print) Steve Renaud	Official Title President	Date (dd-mm-yyyy) 2012/10/10
Signature 	Telephone No. 807-668-2638	





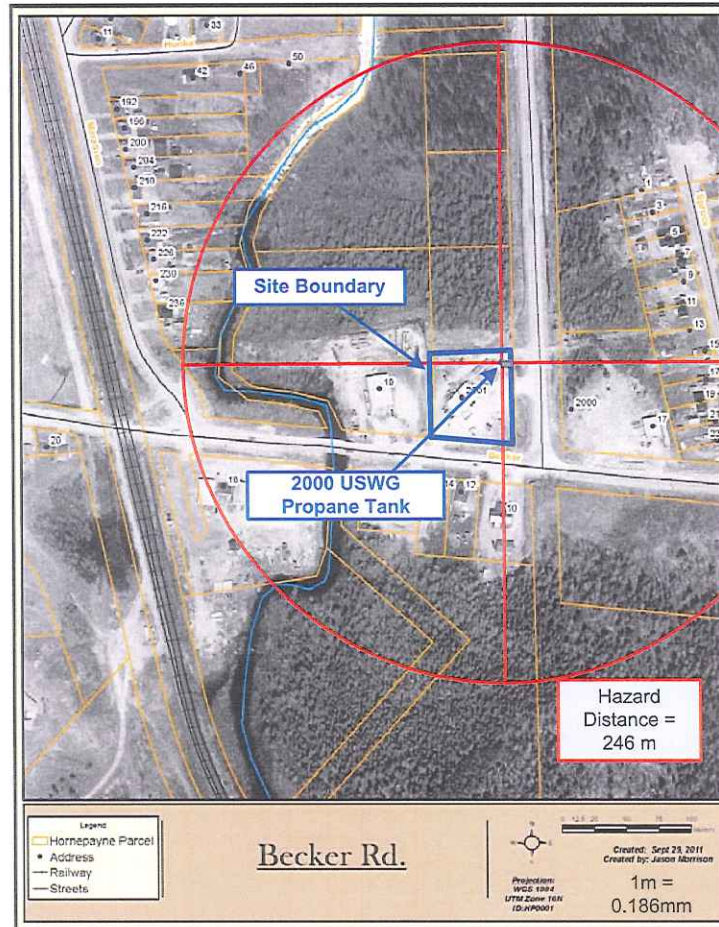


<p><b>Setback Distances to Site Boundary</b></p> <p>North: 11.3 m    East: 8.6 m          South: 62.9 m    West: 53.8 m</p>	<p><b>Municipality (ies) within the 1 psi overpressure circle:</b></p> <p>Township of Hornepayne</p>	<p align="center"><b>Map of Surrounding Area</b></p> <p align="center">Hornepayne Service Centre Inc.          2001 Highway 631 North, Hornpayne, ON P0M 1Z0  <i>Legal Description</i>  <b>CON 3 PART 6 Plan M-63-A</b>  <i>Township of Hornepayne</i></p>
<p><b>Capacity of Propane Storage Tank:</b></p> <p>Capacity of Propane Storage Tank = 2000 USWG</p>	<p><b>Municipal Contact:</b></p> <p>Susan Smith          Clerk, Township of Hornepayne          68 Front Street, Box 370, Hornpayne, ON P0M 1Z0          Tel: 807-868-2020    Fax: 807-868-2787          email: smith.hpayne@bellnet.ca</p>	
<p><b>GPS Co-ordinates of Propane Storage Tank:</b></p> <p>GPS Co-ordinates = 49.212103,-84.765916 approx.</p>		<p>Drawn by: L. Wills                      Date: January 7, 2012</p>
<p><b>Circular Distance to 1 psi overpressure:</b></p> <p>Denoted by circle centred on tank; radial distance = 246 m</p>		

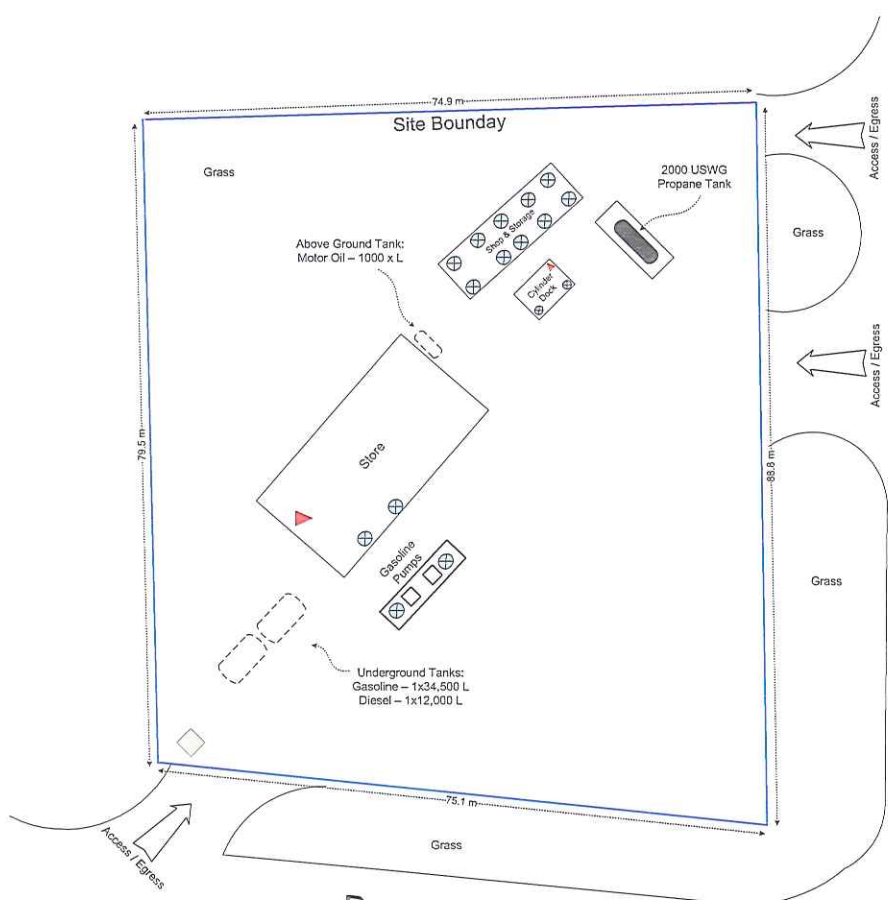

Highway 631 North

Becker Road

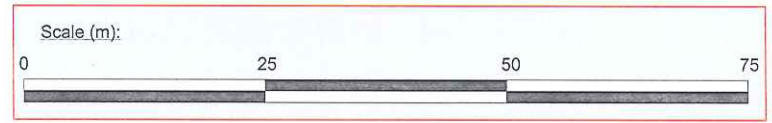

**Key Plan:**



**Notes:**

1. Tank distances to property lines:

Property Line Setbacks	Distance
North	11.3 m
South	62.9 m
East (Front)	8.6 m
West	53.8 m

- 2. Fire Extinguisher
- 3. Egress/Fire Access Route:  
Site is wide open, egress/access points all along Becker Road and Highway 631 North
- 4. E-Stop/ Electric Shut off
- 5. Propane Cylinder Storage Area
- 6. Municipal Fire Hydrant

**FSN Training & Development**

**Site Plan**  
**Hornepayne Service Centre Inc.**  
 2001 Highway 631 North, Hornepayne, ON P0M 1Z0

**Legal Description**

CON 3 PART 6 Plan M-63-A  
 Township of Hornepayne

Drawn by: L. Wills

Checked by:

Date: January 6, 2012

Rev 0