



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

This Level 1 RSMP applies to: • a facility with a total propane storage capacity of 5,000 USWG or less; or
• a facility with a fixed propane storage capacity of exactly 5,000 USWG and no more than 500 USWG of portable propane storage capacity on site.

Failure to fully complete this form may result in rejection. Making a false statement may result in a fine or prosecution under the <i>Technical Standards and Safety Act</i>		For Office Use Only
Licence Number	000070644486	
Check applicable type of propane operations. <input checked="" type="checkbox"/> Cylinder <input type="checkbox"/> Motor Fill <input type="checkbox"/> Filling Plant <input type="checkbox"/> Card/Keylock		
Submit along with this completed application a Facility Site Plan and a Map of the Surrounding Area.		

SECTION A: GENERAL INFORMATION

The Undersigned applies to TSSA for a review for an RSMP under Ontario's *Technical Standards and Safety Act*, Propane Storage and Handling Regulation.

Company Name A Canadian Electrocoating Limited		Corporation No. 670132
Operator Name (if different from above) Same as above		
Telephone No. 5199777523 ext 1111	Fax No.	E-mail mharber@narmco.com
B Street No. 945 Street Name / 911 Number / Address, if applicable Prince Road		
Town / City or Township / County Windsor		Province Ontario
Postal Code N9C2Z4		
Mailing address if different from above.		
C Street No. Street Name / 911 Number / Address, if applicable		
Town / City or Township / County		Province
Postal Code		
Information on Container Refill Centre or Filling Plant		
Location of facility.		
D Street No. 945 Street Name / 911 Number / Address, if applicable Prince Road		
Town / City or Township / County Windsor		Province Ontario
Postal Code N9C2Z4		
Nearest Major Intersection College Street		
Name of Licence Holder Canadian Electrocoating Limited		
Name of a Senior Management person as defined in the regulation holding the Record of Training (ROT). Mike Harber		00000000
Municipality (or municipalities if the facility or its hazard distance touches multiple borders) Windsor		
Hours of operation. <div style="background-color: black; width: 100%; height: 50px;"></div>		

This document is valid until the next licence renewal date. You are required by law to notify TSSA of any change of information.

Declaration: I am aware that it is an offence to give false information in this document and
I hereby declare that the information I have given here is true and complete.

Print name	Date (dd-mm-yyyy)
Name of Licence Holder Canadian Electrocoating Limited	20 APR 2025
Name of Senior Management person as defined in the Regulation holding the Record of Training	



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Indicate the year the facility was established.
1986

Indicate the year of any significant modifications, as defined in s.1, O.Reg 211/01, since establishment.
1994, 2009, 2012

Identify the psig rating and serial number for each fixed propane storage tank on site.

	PSIG	Serial Number
Tank1:	250	430.7
Tank2:		
Tank3:		

Enter capacity of propane in USWG, fixed, portable, and mobile, and provide detailed inventory that includes the number of tank/vessel for each type (fixed, portable, and mobile) and the capacity of each tank/vessel, on a separate document.

Fixed: **2000** Portable: **0** Mobile: **0**

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title	Date (dd-mmm-yyyy) 30 APR 2025
	Plant Manager	
	Telephone No. 437-772-8025	



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION A: GENERAL INFORMATION (cont'd)

Activity Information

Name of Propane Supplier(s) Superior Propane		For Office Use - Party No.	
Street No. 7022	Street Name / 911 Number / Address, if applicable Wellington Road 124		
Town / City or Township / Country Guelph		Province Ontario	Postal Code N1H6L3
Telephone No. 1-888-751-5854	Fax No.	Contact Name Lucky Attwal	
E-mail [REDACTED]			

Name of Propane Transporter. If same as above, please check box. <input type="checkbox"/>		For Office Use - Party No.	
Name of Propane Transporter Superior Propane			
Street No. 700	Street Name / 911 Number / Address, if applicable Jamieson Parkway #102		
Town / City or Township / Country Cambridge		Province Ontario	Postal Code N3C4N6
Telephone No. 1-888-781-5854	Fax No.	Contact Name Matt Smith	
E-mail [REDACTED]			

Off-site Cylinder and/or Mobile Storage		Capacity stored off-site, in USWG	For Office Use - Party No.
Street No.	Street Name / 911 Number / Address, if applicable		
Town / City or Township / Country		Province	Postal Code
Telephone No.	Fax No.	Contact Name	

Note: Customer storage is not considered off-site storage.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) [REDACTED]	Official Title Plant Manager
	Telephone No. 437-772-8025
	Date (dd-mmm-yyyy) 30 APR 2025



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN

The licence holder will complete Section B in consultation with the local Fire Services.

Description of the maximum volume, types and storage location of other hazardous materials on site, if any.

Acetylene - (3) Portable Oxy/Acetylene carts, total 129.9 litres - (added to facility map)

Oxygen - (3) Portable Oxy/Acetylene carts, total 75.0 litres - (added to facility map)

Argon - (3) Portable Welding carts total 189 litres - (added to facility map)

BlueShield 6 - (5) Portable Welding Carts total 250 litres - (added to facility map)

Description of fire and emergency equipment indicated on facility site map.

Fire hose cabinets - (Added to facility map)

Sprinkler System - (added to facility map)

Fire extinguishers located in strategic areas throughout the facility - (Added to facility map)

List of fire protection controls (e.g., fire detection systems, fire notification systems, alarm systems, automatic shut off devices, fusible links, etc.) and describe their function, use and operation.

Alarm system annunciator panel (zone location identified) (Added to facility map)

Fire hose cabinets

Sprinkler system installed - fire suppression throughout the facility

Fire extinguishers located throughout the facility


Maintenance and testing schedule for fire protection controls and devices.

Fire Suppression - sprinkler system is tested annually by Classic Fire & Life Safety and is tagged as such

Fire extinguishers - Inspected monthly by Classic Fire & Life Safety. Tags on fire extinguishers are updated monthly.

Fire hoses - Inspected and tested annually by Classic Fire & Life Safety

Declaration: I am aware that it is an offence to give false information in this document and
I hereby declare that the information I have given here is true and complete.

	Official Title Plant Manager	Date (dd-mmm-yyyy) 30 APR 2025
	Telephone No. 519-977-7523 ext 1111	



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

1. Contacts for Emergency Response

1. Facility Contact Personnel - Key Contact		5. Facility 24-Hour Contact Person	
Name <u>John Meinhardt</u>	For Office Use - Party No.	Name <u>Zeljko Komlenac</u>	For Office Use - Party No.
Official Title <u>Corporate Manufacturing Manager</u>		Official Title <u>Maintenance Manager</u>	
Telephone No. <u>519-977-7623 ext 1158</u>	Fax No. <u>519-977-6686</u>	Cell No. <u>519-932-5648</u>	Fax No. <u>519-977-6686</u>
E-mail <u>jmeinhardt@narmco.com</u>		E-mail <u>zkomlenac@narmco.com</u>	
Role and responsibilities in emergency <u>Senior Manager in Charge</u>		Role and responsibilities in emergency <u>Response Liaison</u>	
2. Facility Contact Personnel - Alternate Contact		6. Name of Facility Manager	
Name <u>Mike Harber</u>	For Office Use - Party No.	Name <u>Mike Harber</u>	For Office Use - Party No.
Official Title <u>Plant Manager</u>		Official Title <u>Plant Manager</u>	
Telephone No. <u>437-772-8025</u>	Fax No. <u>519-977-6686</u>	Telephone No. <u>519-977-7523 ext 1111</u>	Fax No. <u>519-977-6686</u>
E-mail <u>mharber@narmco.com</u>		E-mail <u>mharber@narmco.com</u>	
Role and responsibilities in emergency <u>Senior Manager in Charge</u>		Role and responsibilities in emergency <u>Senior Manager in Charge</u>	
3. Local Fire Services - Key Contact		7. Propane Supplier Key Contact Person	
Name <u>James Waffle</u>	For Office Use - Party No.	Name <u>Lynn Obermeyer</u>	For Office Use - Party No.
Official Title <u>Fire Chief</u>	E-mail	Official Title <u>Market Manager</u>	E-mail <u>lynn_obermeyer@superiorpropane.com</u>
Telephone No. <u>519-263-3016 ext 3753</u>	Fax No.	Telephone No. <u>1-877-873-7467</u>	Fax No.
Role and responsibilities in emergency <u>Incident Commander</u>		Role and responsibilities in emergency <u>Manage the situation by putting place specific procedures appropriate to the type of emergency.</u>	
Fire Services Address		Propane Supplier Address <u>7022 Wellington Road 124 Guelph Ontario N1H6L3</u>	
4. Local Fire Services - Alternate Contact		8. Municipal Contact	
Name <u>Darren Hart</u>	For Office Use - Party No.	Name	For Office Use - Party No.
Official Title <u>Deputy Chief of Operations</u>	E-mail	Official Title <u>City Clerk</u>	
Telephone No. <u>519-263-3016 ext 3772</u>	Fax No.	Telephone No. <u>519-255-2489</u>	Fax No. <u>519-255-6868</u>
Role and responsibilities in emergency <u>Incident Commander</u>		E-mail <u>clerks@citywindsor.ca</u>	
Fire Services Address		Municipality Name and Address <u>Windsor 350 City Hall Square West</u>	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title <u>Plant Manager</u>
	Telephone No. <u>437-772-8025</u>
	Date (dd-mm-yyyy) <u>30 Apr 2025</u>



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

2. Additional Safety Measures

Describe any other measures in place at the facility that exceed the minimum Code and Standards requirements.

There are currently no measures that exceed the Minimum Codes or Standards

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) <u>Mike Harber</u>	Official Title <u>Plant Manager</u>
Signature	Telephone No. <u>437-772-8025</u>
	Date (dd-mm-yyyy) <u>17-Feb-2025</u>



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propane@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

3. Record of Emergency Training Provided - For most recent 12-month period.

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Training Date (dd-mmm-yyyy) 28-Feb-2025	Print Name of Training Provider: Allison Waddell
	Print Name of Instructor: Allison Waddell
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Training Date (dd-mmm-yyyy) 28-Feb-2025	Print Name of Training Provider: Allison Waddell
	Print Name of Instructor: Allison Waddell
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Training Date (dd-mmm-yyyy) 19-Jul-2022	Print Name of Training Provider: Canadian Propane Association
	Print Name of Instructor: Paul Dewe
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Training Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title
[Redacted]	PLANT MANAGER
S [Redacted]	Telephone No.
	437-772-8025
	Date (dd-mmm-yyyy)
	30 APR 2025



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

4. Emergency Training Plan for Coming Year

Training on Emergency Response Plan and Procedures provided to facility key contacts.

Target Date (dd-mmm-yyyy) 01-Feb-2026	Print Name of Training Provider: Alexandra Strong
	Print Name of Instructor: Alexandra Strong
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Training on the facility's Emergency Management Procedures provided to staff.

Target Date (dd-mmm-yyyy) 01-Feb-2026	Print Name of Training Provider: Alexandra Strong
	Print Name of Instructor: Alexandra Strong
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

On-site specific training provided to certificate holders / persons with Records of Training.

Target Date (dd-mmm-yyyy) 01-Jul-2025	Print Name of Training Provider: Canadian Propane Association
	Print Name of Instructor: Paul Dawe
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:
Target Date (dd-mmm-yyyy)	Print Name of Training Provider:
	Print Name of Instructor:

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title
[Redacted]	Plant Manager
	Telephone No.
	437-772-8025
	Date (dd-mmm-yyyy)
	30 APR 2025



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

5. Emergency Response Communications Plan

Warnings and Actions

Describe who gives warnings to whom, and how and when the warning will be given (including public notification as appropriate).

All staff are trained annually in emergency response/plant evacuation drills.

There is an existing warning system installed in this facility. The system of notification is a button activated audible alarm that is heard throughout all areas of the plant.

Public notifications would come by way of incident commander with Windsor Fire & Rescue and the Windsor Police Services.

Describe what action is to be taken and by whom when a warning is issued (including details of a meeting place in a safe identified area and activating the evacuation plan, if necessary).

Senior Manager on site will notify customers, contractors and employees verbally.

Senior manager on site at the time will activate the evacuation alarm and all personnel will evacuate the premises through the front (Prince Road) of the plant.

The meeting place will be Maryvale School across the street @ 940 Prince Road, Windsor, Ontario.

Plant Manager and Corporate Management will also be notified in case incident occurs after regular office hours.

Communication with Emergency Response Authorities

Describe when and how the licence holder will give early warning to emergency response authorities (including a process to ensure that a call is placed to 911).

The license holder or senior manager on site will call 911 in the event of an emergency. The call will be made from the facility phone or a cell phone carried by the license holder or the manager.

Describe provisions for fire department entry when there are no operations or staffing at the propane site.

Before leaving the property, truck access gate will be held open mechanically to allow unrestricted access to the property.

Access to the tank is possible from both the East and West sides of the property.

Describe how the licence holder will ensure continual flow of updated information to authorities.

This will be accomplished through the Corporate Officers and through the Human Resources Department

The license holder or designated facility emergency response liaison will be available to the local fire department as indicated on page 5

How long will it take the facility liaison person to respond to the site.

Facility Liaison can be on site in 5 minutes.

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title
[Redacted]	Plant Manager
	Telephone No.
	437-772-8025
	Date (dd-mm-yyyy)
	30 APR 2025



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

6. Building and Site Security and Procedures

	Yes	No
1. Does the propane location have controlled access to limit unnecessary risk and entry (lock out procedures)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Is there adequate night lighting at the site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. Are procedures in place that ensure access routes, aisles, storage area, filling areas and the grounds are kept clear from unwanted materials?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4. Are there procedures that capture and record the daily inspection of hoses and inspection requirements for filling systems and mechanical devices used in the transfer of propane?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5. Does the facility have procedures that include a process to isolate and purge any overfilled propane cylinders?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
6. Are weighing systems validated for accuracy?	<input type="checkbox"/>	<input checked="" type="checkbox"/>
7. Are storage areas clearly marked with the vessels' capacity status (i.e., filled, empty, purged and other hazardous materials)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8. Are quality assurance procedures in place to ensure that all valves are closed after the propane cylinders are filled?(e.g., QCC valves)	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9. Is the schedule of maintenance and testing activities retained on site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>

7. Water Supply

The propane licence holder should work with the local fire department to determine water supply capabilities that are available based on the propane facility's location.

	Yes	No
1. Is a pressurized water system available at the propane facility site?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. Can the municipal fire department pump 375 GPM (1420 LPM) of water at this location?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3. What is the unobstructed distance to the closest water supply that could be used for firefighting activities? (distance in metres only)	<u>82 metres</u>	
4. What is the unobstructed distance to the closest approved water supply with year round access if there are no hydrants? (distance in metres only)	<u>82 metres</u>	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title
[REDACTED]	Plant Manager
	Telephone No.
	437-772-8025
	Date (dd-mmm-yyyy)
	30 APR 2025



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION B: EMERGENCY AND PREPAREDNESS RESPONSE PLAN (cont'd)

The licence holder will complete Section B in consultation with the local Fire Services.

8. Licence holder and local Fire Services Review

To be completed by the Local Fire Services

Has the local fire service had an opportunity to review the Emergency Response and Preparedness Plan?

Yes ☒ No ☐

If not, please explain (e.g., no fire services).

Fire services comments, if any: *After a site visit and verifying installation and training procedures, there are no concerns as per Windsor Fire and Rescue Services - April 30/2025*

To be completed by the Licence Holder

In response to the above comments, the following action(s) is required:

The licence holder will respond to the Local Fire Services comments by:

(dd-mmm-yyyy)

LOCAL FIRE SERVICES

The undersigned has reviewed Section B of the Risk and Safety Management Plan Fire Services.

Local Fire Services Name	Print name	Date (dd-mmm-yyyy)
<i>FPO</i>	<i>Chris Kreibich</i>	<i>April 30/25</i>

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title
	<i>Plant Manager</i>
	Telephone No.
	<i>437-772-8025</i>
	Date (dd-mmm-yyyy)
	<i>30 APR 2025</i>



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS

Applicant must include a Facility Site Plan and Map of Surrounding Area

Facility Site Plan.

The licence holder will submit a copy of the original facility site plan updated with the following information:

1. The storage location of fixed, portable, and mobile vessels.
2. The maximum volume, types and storage location of hazardous materials.
3. Location of permanent structures on site.
4. Access and egress points and location of barriers.
5. Location of fire and emergency equipment (e.g., sprinkler systems, extinguishers, suppression systems) on site and location of fire hydrant or water supply where available.
6. Location of emergency shut off/shut down switches/valves.

Map of Surrounding Area.

The licence holder will submit a scaled aerial map of the surrounding area showing the following information:

7. The capacity and placement of the single largest propane storage vessel, including its setback from the front, rear and side property lines.
8. GPS co-ordinates of the single largest vessel.
9. Visual indication of the single largest fixed vessel and a circle made using the distance in Table 1 as the radius from the single largest fixed vessel.
10. Clear indication of the municipality or municipalities present within the circle.
11. Visual indication of property line information.
12. The location and name of roads within or abutting the site.
13. Key note to the drawing indicating the facility's municipal address, municipal lot number(s) and concession lines as applicable, and the date the map was prepared.
14. Address and contact information for each municipality (municipal clerk or secretary-treasurers of planning board). (Refer to page 5.)
15. Complete "Required Mapping Information from Updated Site Plan" in table below :

Required Mapping Information from Updated Site Plan

Date map prepared (dd-mmm-yyyy) 17-Feb-2025	Capacity of single largest propane storage vessel (USWG) 2000
Tank setback coordinates. Indicate placement on the map.	
Front: 206.29m (North)	Right side property line: 48.36m (East)
Rear: 250.75m (South)	Left side property line: 121.01m (West)
GPS coordinates of single largest vessel: 42.17 16.0 N/83.04.31.8 W	

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print) [Redacted]	Official Title Plant Manager
Telephone No. 437-772-8025	Date (dd-mmm-yyyy) 30 APR 2025



Technical Standards and Safety Authority
 345 Carlingview Drive
 Toronto, Ontario M9W 6N9
 Tel: 416.734.3300
 Fax: 416.231.4078
 Customer Service: 1.877.682.8772
 propane@tssa.org
 www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

SECTION C: SUBMISSIONS (cont'd)

Applicant must include a Facility Site Plan and Map of Surrounding Area


Table 1: Distance Table

Water Capacity (litres)	Nominal Water Capacity (USWG)	Distance to 1 psi overpressure (m)
1,890	500	155
3,780	1,000	195
4,920	1,300	213
6,620	1,750	235
7,130	1,885	241
7,560	2,000	246
18,900	5,000	333

Formula: $D = 16.94 \times (1.524 \times C)^{1/3}$
 D = Distance to overpressure of 1 psi (meters)
 C = Tank Total Capacity in USWG

Parameters: Density of Propane is 0.5033 kg per litre @ 15 C
 Assume all vessels are 80% full
 1 gallon [US, liquid] = 0.003785411784 cubic meter
 1 cubic metre = 264.17 USWG

Hazard Distance Chart (EPA-TNT model)

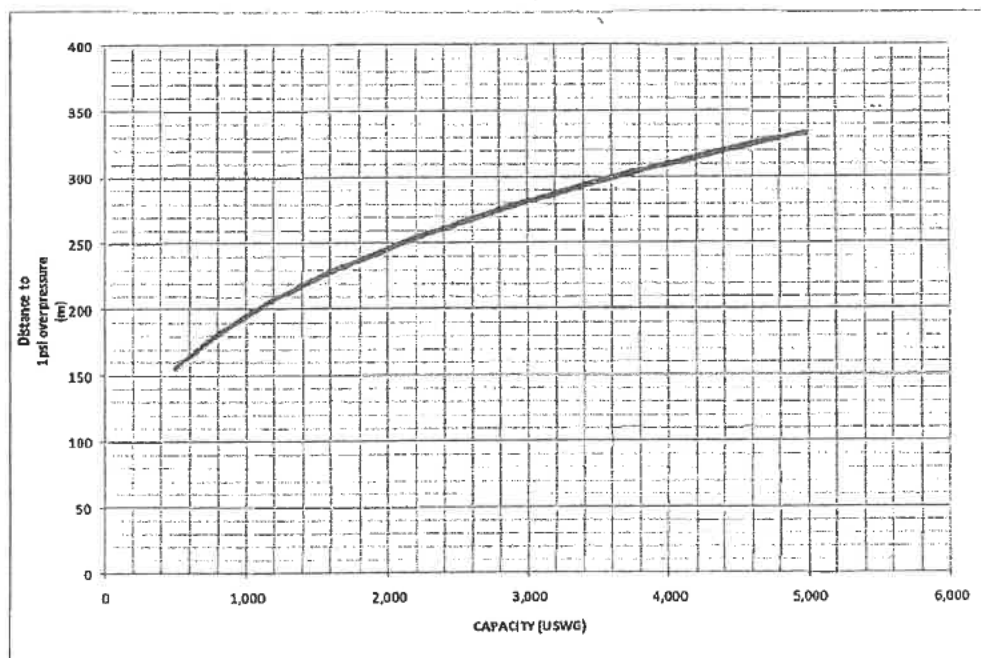



Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
 Propane Storage and Handling Regulation

Applicant must include a Facility Site Plan and Map of Surrounding Area

As an accompaniment to the Map of Surrounding Area, provide the following information about buildings and features present within the circle in Table 2.

Table 2: Buildings and Features

Buildings and Features Present within the Circle on the Map of the Surrounding Area AND Name and Address of Closest Building or Feature	Number of Buildings and Features (mark with an "X")				Distance from Tank to Closest Building or Feature
	0	1	2-10	11+	
Industrial buildings or parks or golf courses Name: Shur-Lok Products Address: 735 Prince Road City: Windsor Province Ontario Postal Code N9C2Z2			X		100 m
Residential building units specifically permanent single family dwellings, condominiums, and apartments Name: Address: City:					m
Commercial building units specifically retail, restaurants, entertainment, theatres, and sporting complexes. Name: Mc Mac Park Address: 1125 Prince Road City: Windsor Province Ontario Postal Code N9C1Z2		X			m
Commercial building units – continuous occupancy specifically hotels, campgrounds, and resorts. Name: Address: City: Province Postal Code					m
Sensitive institutions specifically hospitals, schools and day cares, nursing and retirement homes, mental health institutions, and prisons. Name: Address: City: Province Postal Code					m
Emergency responders specifically fire stations, ambulance stations, and police stations. Name: Address: City: Province Postal Code					m

* For multi-unit buildings, count each unit as "1".

Declaration: I am aware that it is an offence to give false information in this document and I hereby declare that the information I have given here is true and complete.

Name of person completing this form (please print)	Official Title Plant Manager	
	Telephone No. 437-772-8025	Date (dd-mm-yyyy) 30 APR 2025



Technical Standards and Safety Authority
345 Carlingview Drive
Toronto, Ontario M9W 6N9
Tel: 416.734.3300
Fax: 416.231.4078
Customer Service: 1.877.682.8772
propanelicensing@tssa.org
www.tssa.org

Level 1 Risk and Safety Management Plan (RSMP)
Technical Standards and Safety Act
Propane Storage and Handling Regulation

WORKSHEET

Portable Storage Additional Information Worksheet


Cylinder Size	Capacity in USWG	Quantity	Total Volume in USWG
# 420	123.9		
# 100	29.5		
# 40	11.75		
# 33.3	9.62		
# 30	8.8		
# 20	5.8		
# 10	2.9		
# 5	1.5		
Total Cylinder Capacity			


Tanks Stored On-site Not Connected for Use

Tank Size In USWG	Quantity	Total Volume In USWG
2000 USWG	1	2000 USWG
Total Tank Capacity		

Total Cylinder Capacity	
Total Tank Capacity	2000 USWG
Total Portable Capacity (Total Cylinder Capacity + Total Tank Capacity)	

*Information provided in this application is releasable under the Freedom of Information and Privacy Protection Act and may be disclosed upon request.

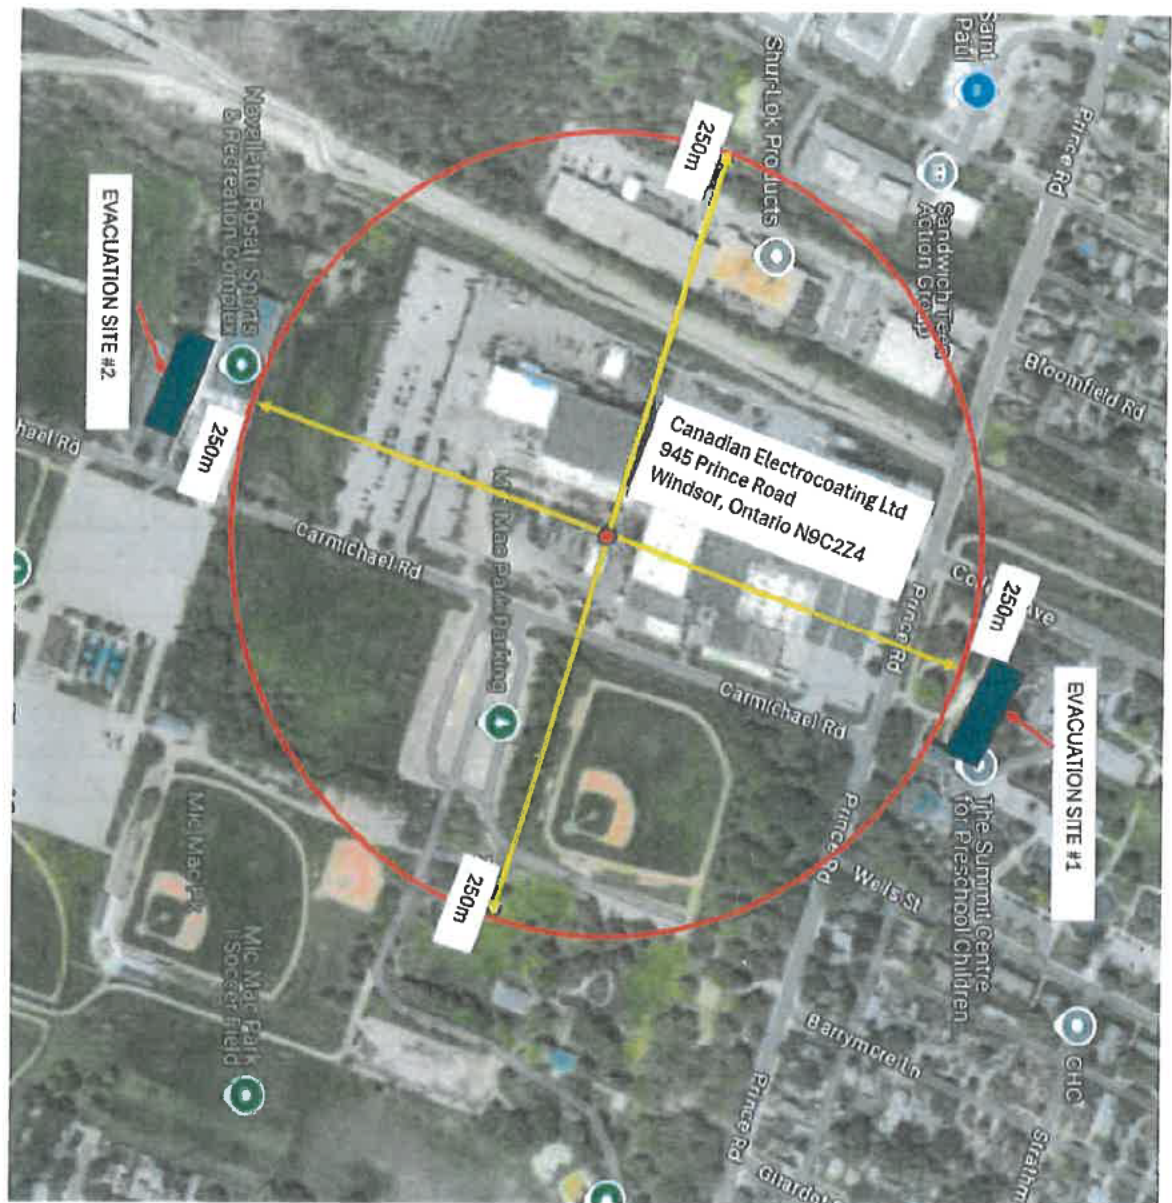

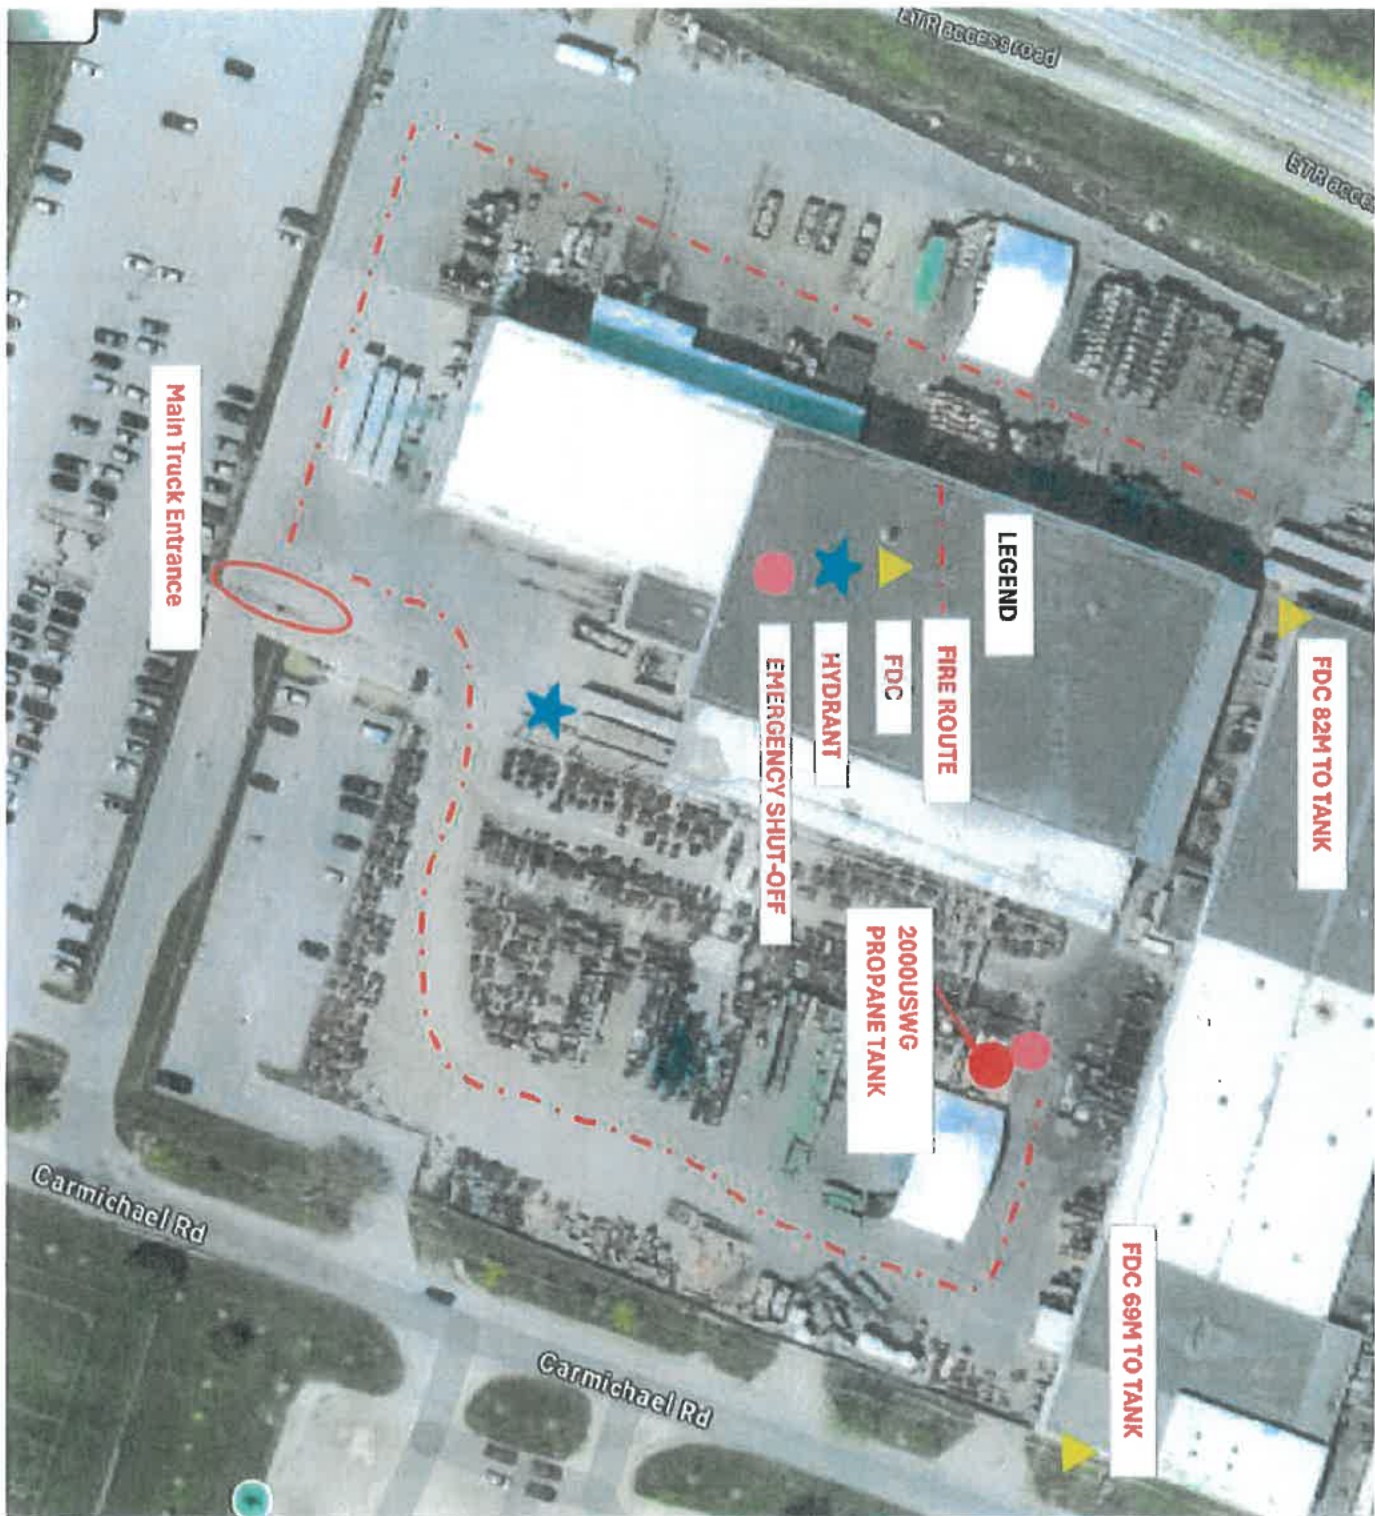

Notes:
Riser for new building is located behind Press 1126

LEGEND



CEL PLANT 2




Project Name	CEL PLANT 2
Project Address	1000 1st St, Suite 200, San Francisco, CA 94107
Project Phone	415.774.1000
Project Fax	415.774.1001
Project Email	cel@celgroup.com
Project Website	www.celgroup.com









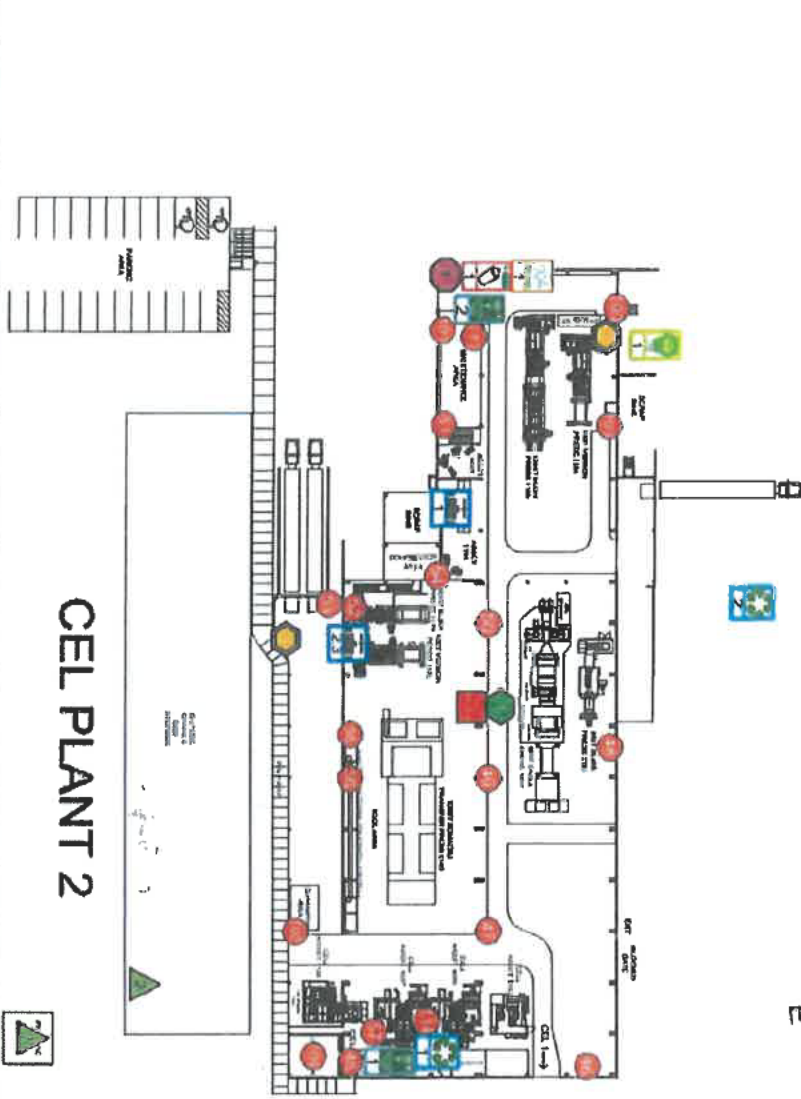




CEL PLANT 2 LAYOUT


UPDATED ON: 06 NOV 23

Project Name	CEL PLANT 2
Project Address	1000 1st St, Suite 200, San Francisco, CA 94107
Project Phone	415.774.1000
Project Fax	415.774.1001
Project Email	cel@celgroup.com
Project Website	www.celgroup.com



- ### LEGEND
-  - Spill Kit (1)
 -  - Battery Acid Spill Kit (1,2)
 -  - Oil Rag Disposal (1)
 -  - Recycle Bin (1,2)
 -  - Aerosol Can Disposal (1)
 -  - Light Bulb Disposal (1)
 -  - Backflow (3)
 -  - Privatizer
 -  - Eye Wash Station (2)
 -  - Emergency Tool Box
 -  - Lube Hold Area (1)
 -  - Gas Cylinder Storage (2)
 -  - Fire Extinguisher

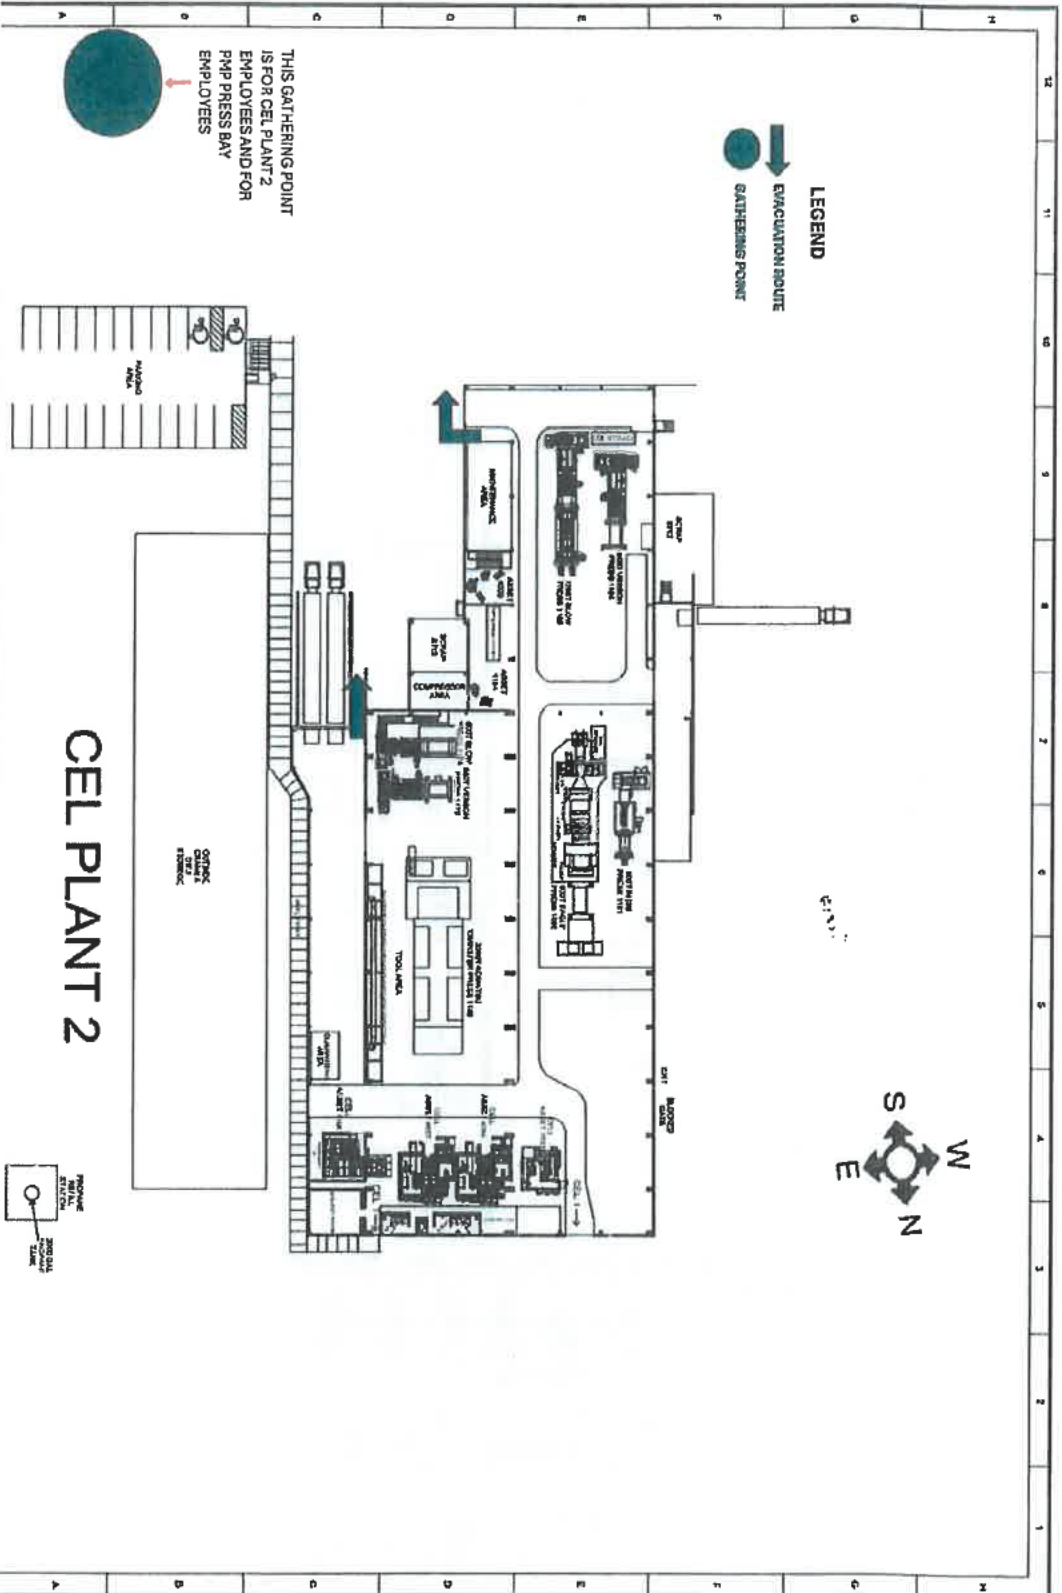


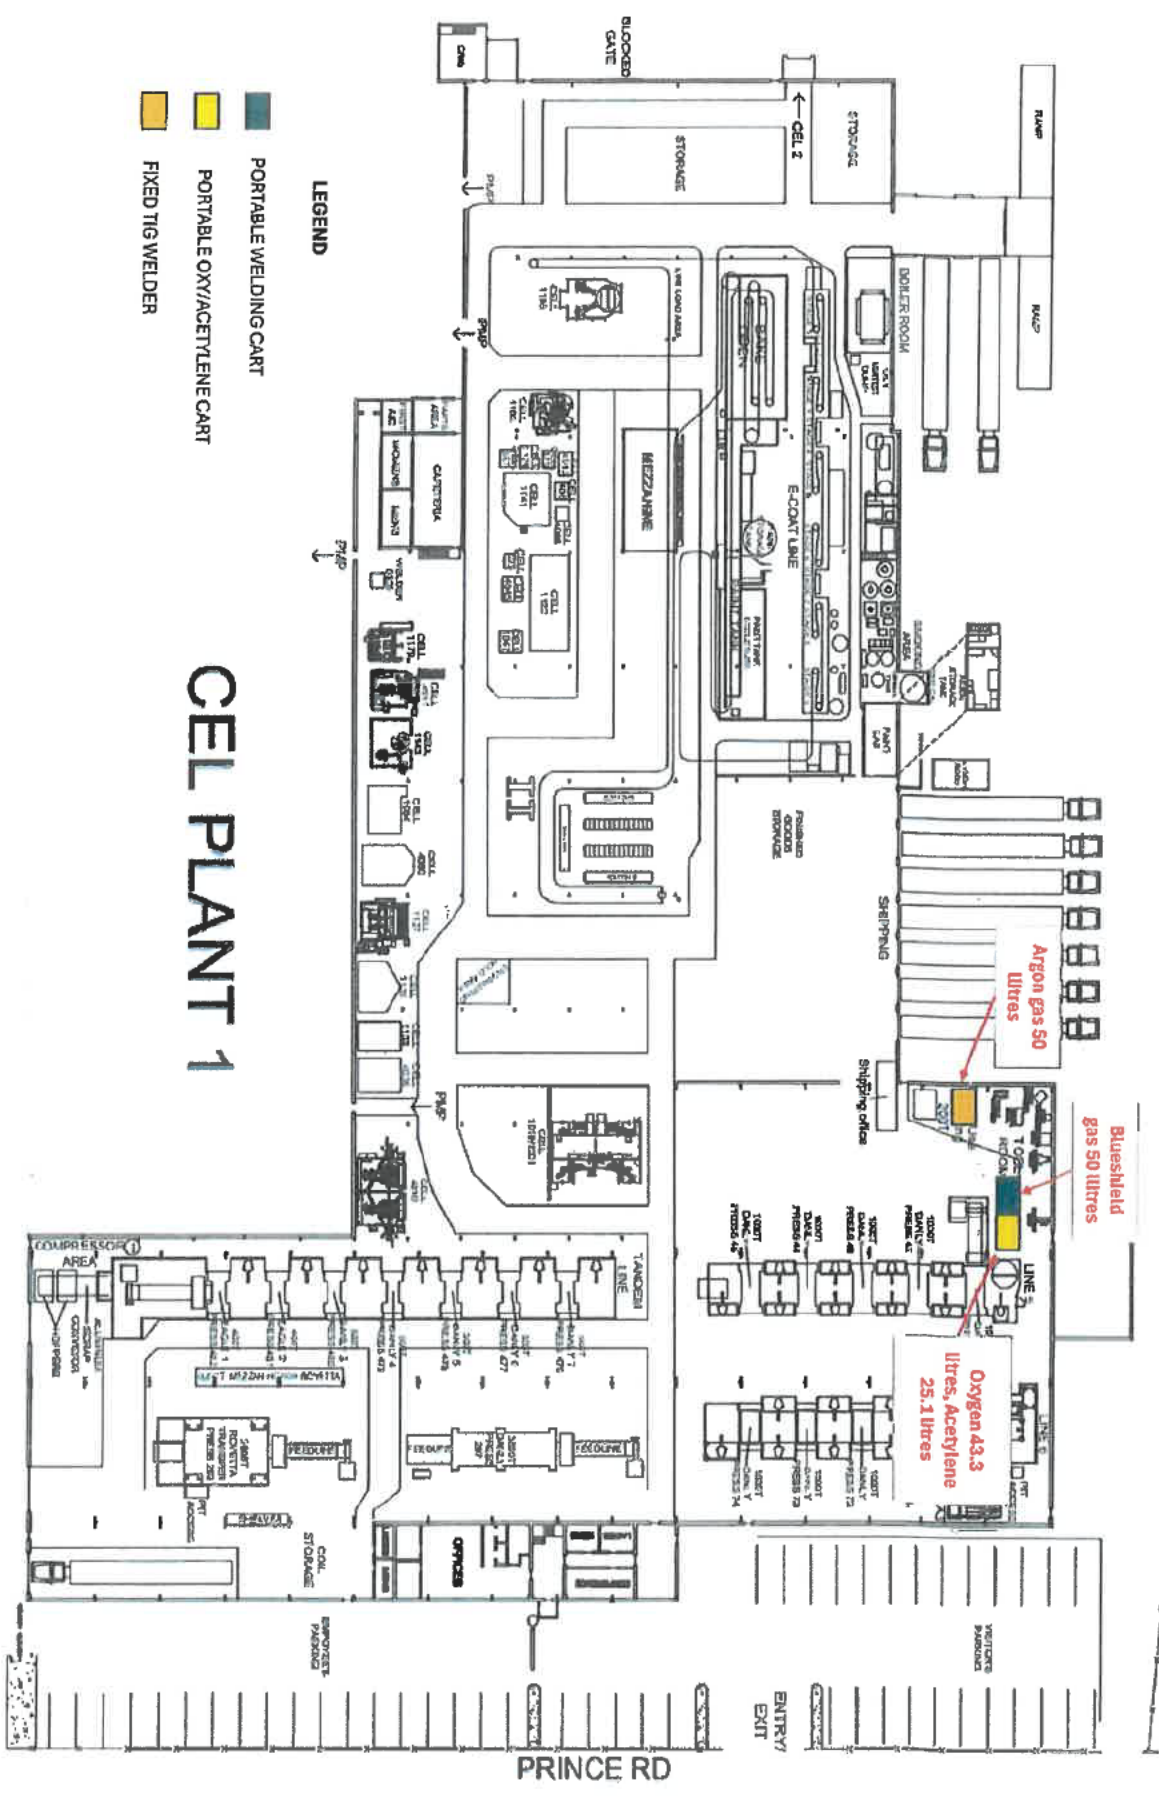

- LEGEND**
- PORTABLE WELDING CART
 - PORTABLE OXY/ACETYLENE CART
 - FIXED TIG WELDER

CEL PLANT 1

CARMICHAEL RD

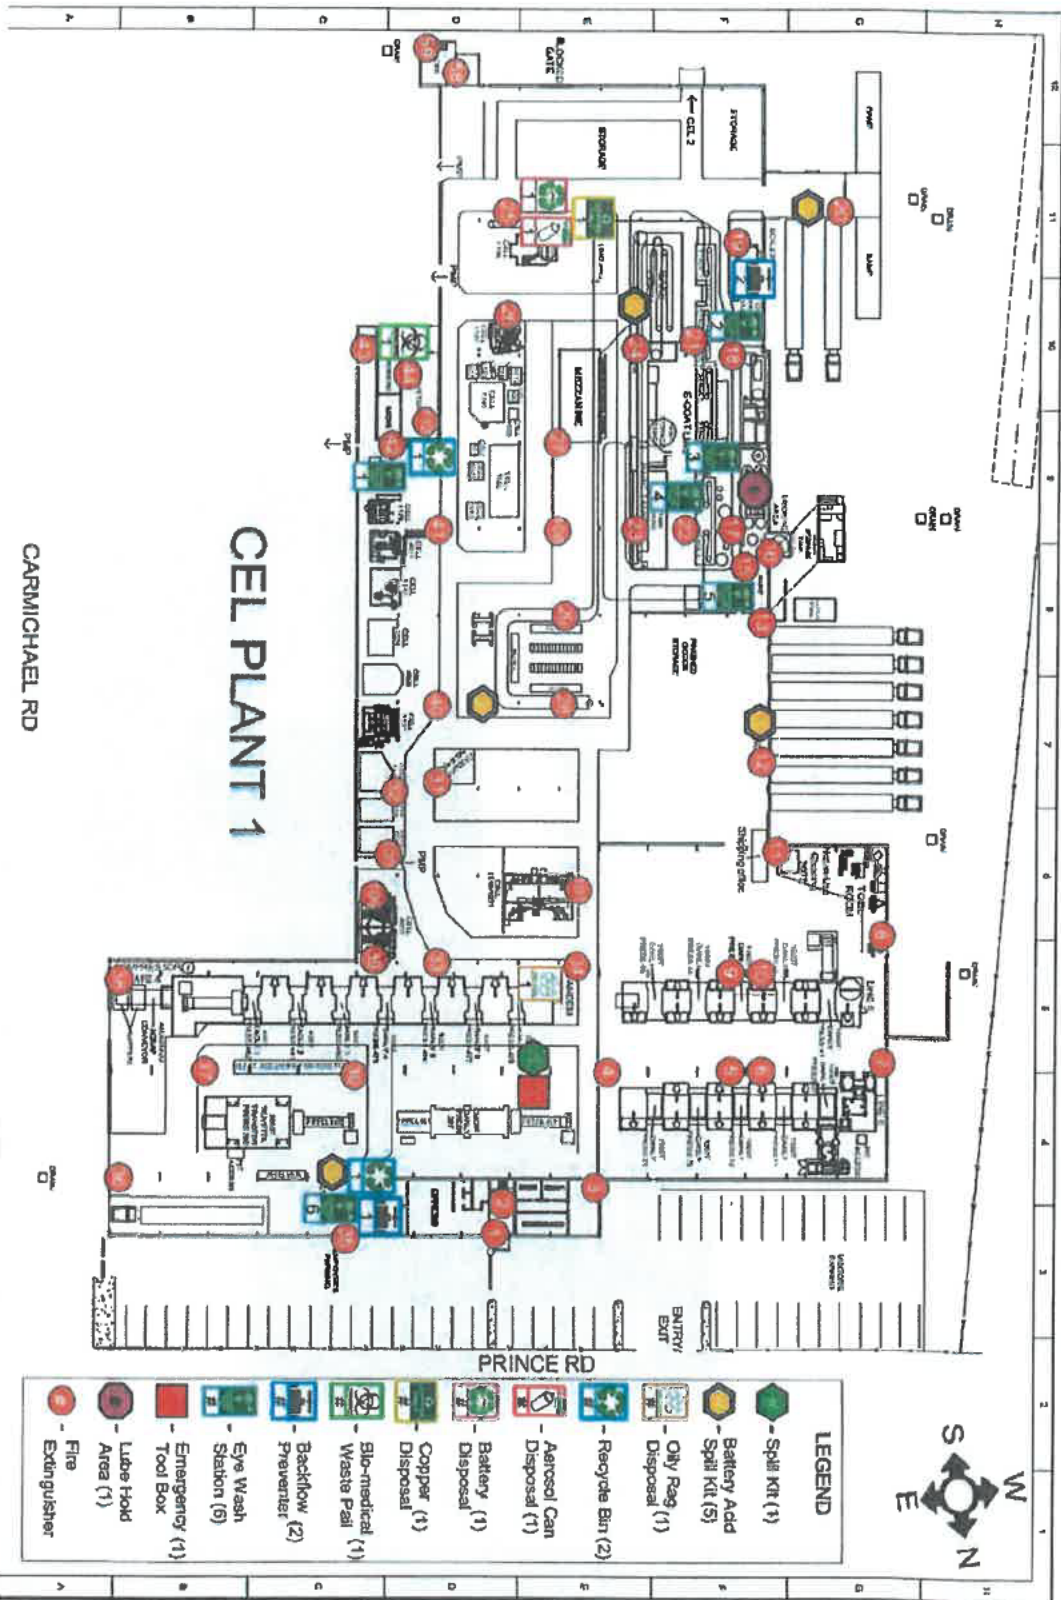

THE NAFICO GROUP

2010 AVENUE ROAD
WINDSOR, ONTARIO
N9C 2Z1
TEL: (519) 899-8279
FAX: (519) 899-8279

CEL

945 PRINCE ROAD
WINDSOR, ONTARIO
N9C 2Z1

CEL PLANT 1

WASTE BINS & FIRE EXTINGUISHERS LAYOUT

UPDATED ON: 24 OCT 24

BY: [Signature]

DATE: [Signature]


REVIEWED BY: [Signature]

DATE: [Signature]


CONFIDENTIAL

NOT FOR DISSEMINATION

THIS DOCUMENT IS THE PROPERTY OF CEL GROUP. IT IS TO BE KEPT IN A SECURE LOCATION AND NOT TO BE LOANED, REPRODUCED, COPIED, OR DISSEMINATED TO ANY OTHER PERSON OR ORGANIZATION WITHOUT THE WRITTEN PERMISSION OF CEL GROUP. IT IS TO BE DESTROYED WHEN NO LONGER REQUIRED.

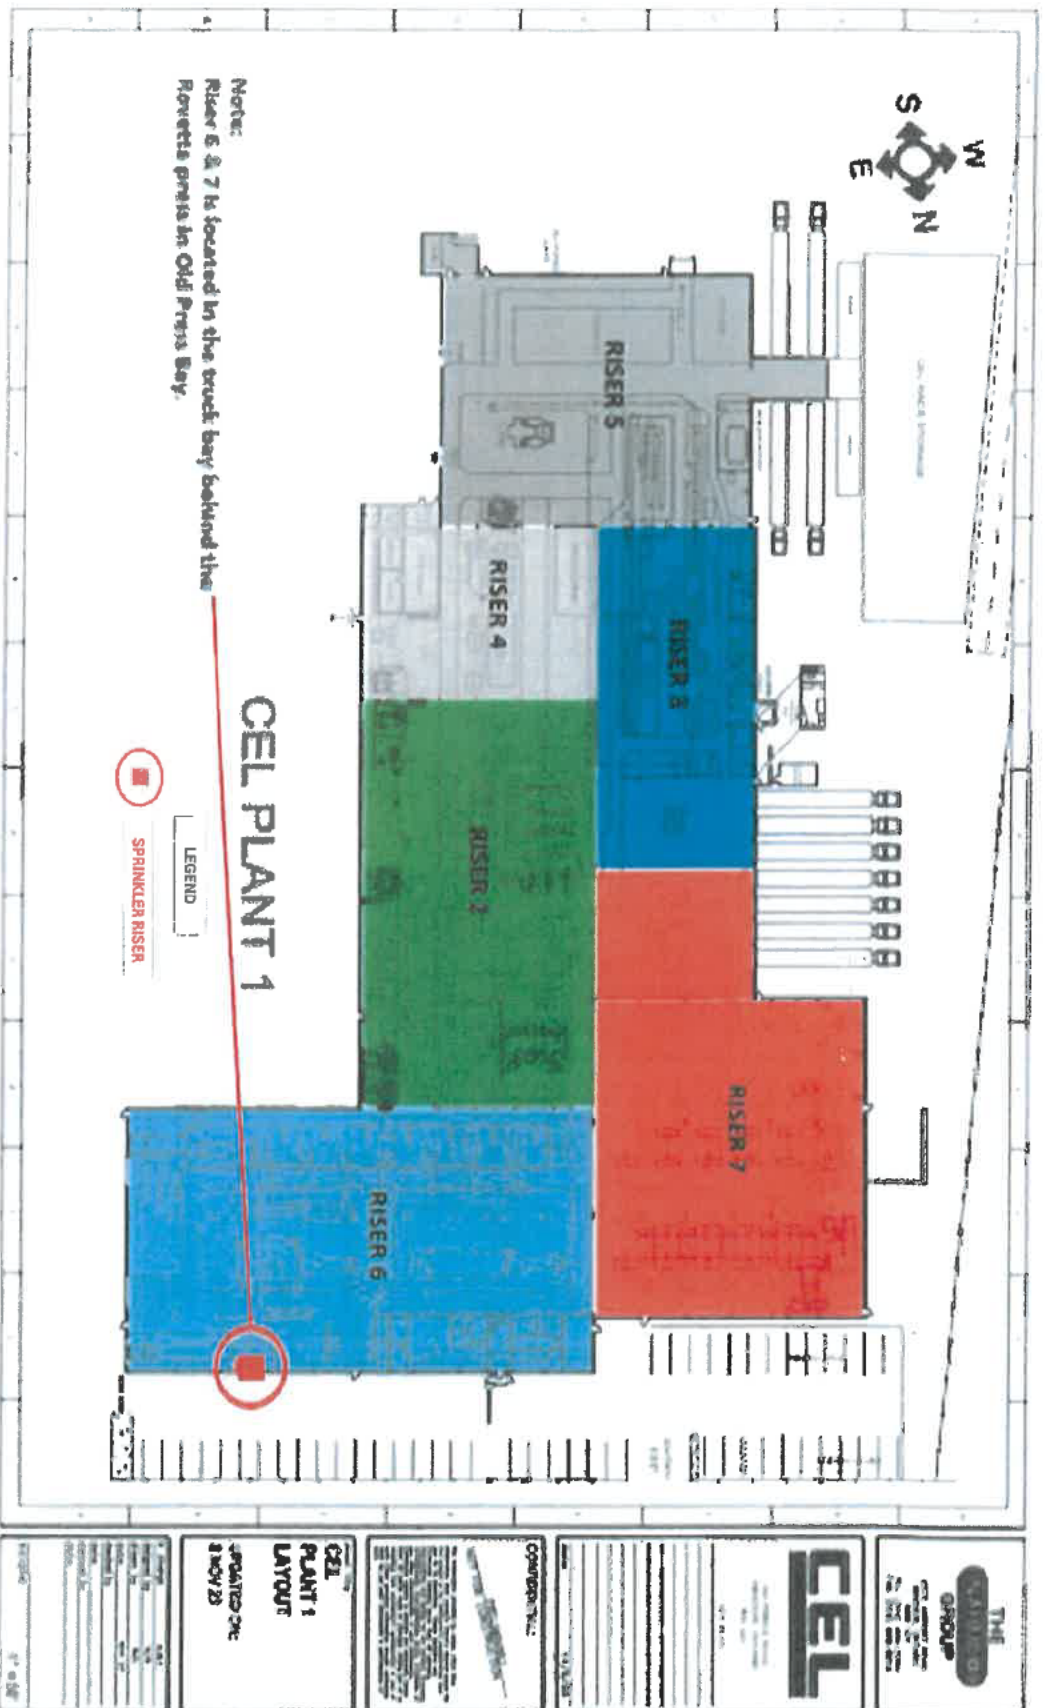

Note:
Riser 6 & 7 is located in the truck bay behind the
Roverette pits in Old Parris Bay.

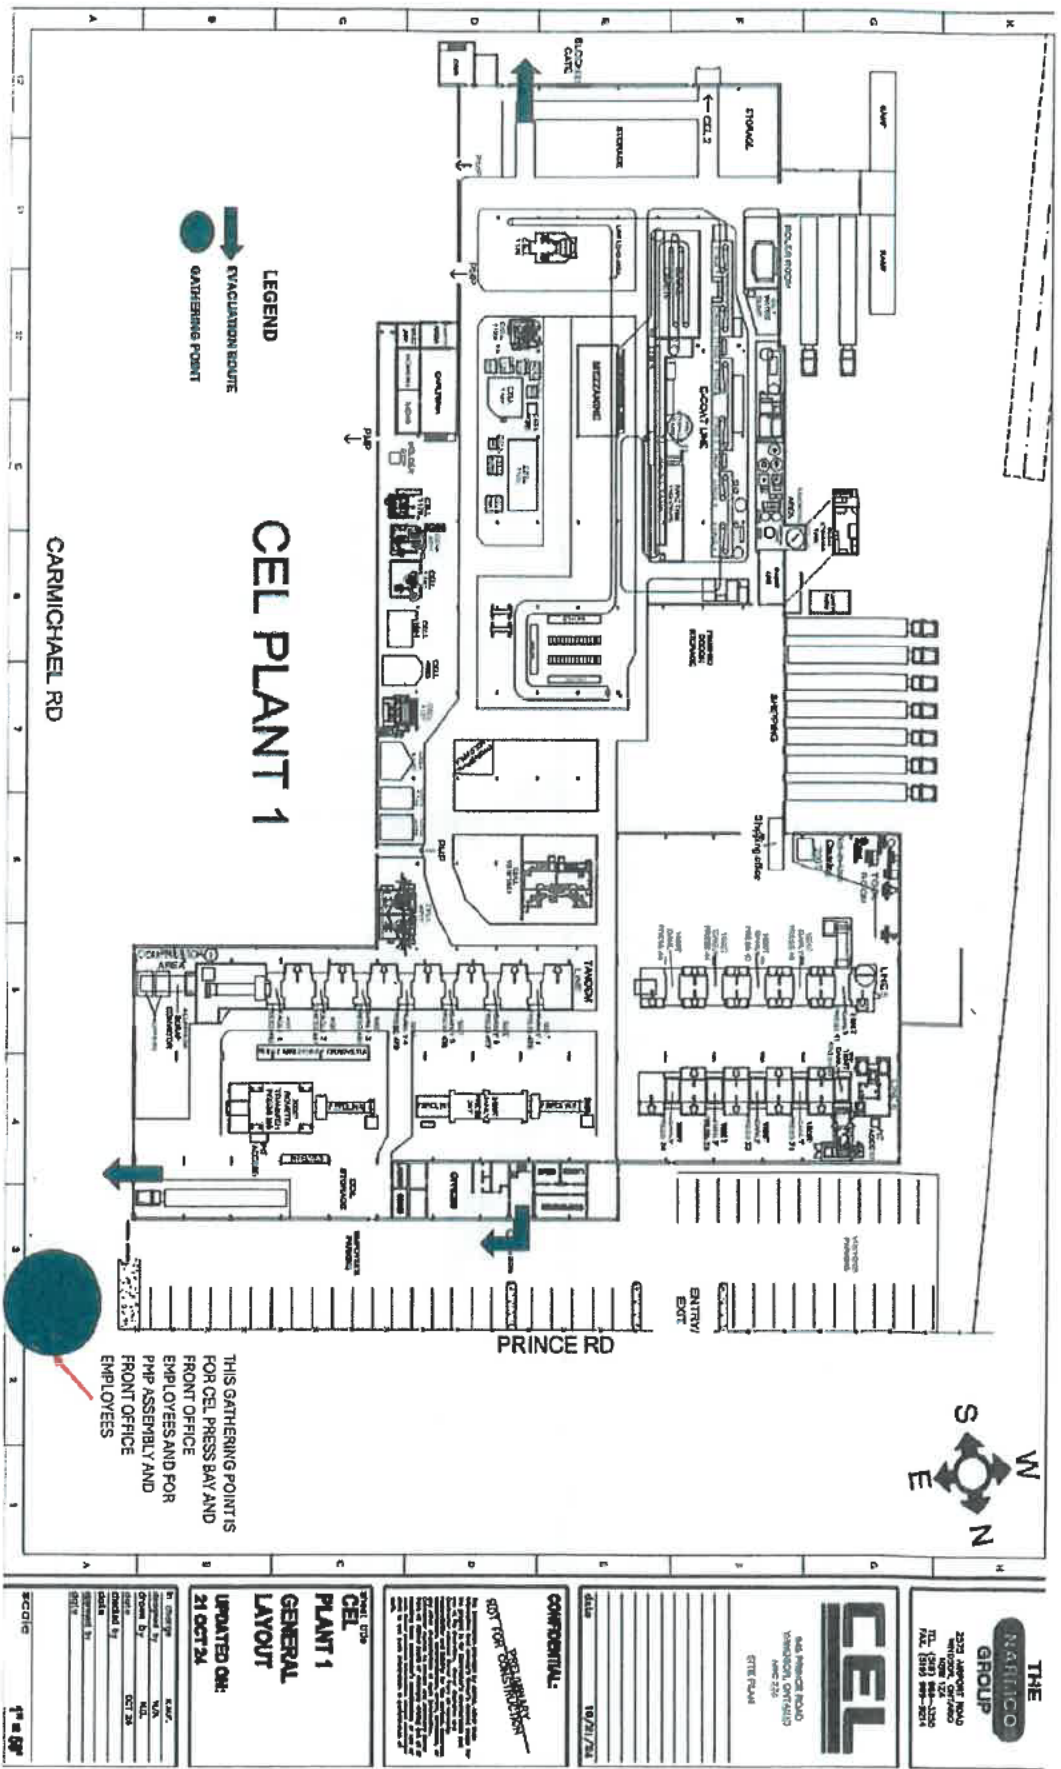

THE MARIANO GROUP

2025 JAMPER ROAD
WINDSOR, ONTARIO
N9A 2G5
TEL: (519) 899-2024
FAX: (519) 899-2024

CEL

444 JAMPER ROAD
WINDSOR, ONTARIO
N9A 2G5
TEL: (519) 899-2024

CONFIDENTIAL

NOT FOR CONSTRUCTION

DATE: 10/21/24

CELL PLANT 1

GENERAL LAYOUT

UPDATED ON: 21 OCT 24

REVISIONS

NO.	DESCRIPTION	DATE
1	Initial Design	10/21/24
2	Revised Design	10/21/24
3	Final Design	10/21/24


CELL PLANT 1

GENERAL LAYOUT

UPDATED ON: 21 OCT 24

REVISIONS

NO.	DESCRIPTION	DATE
1	Initial Design	10/21/24
2	Revised Design	10/21/24
3	Final Design	10/21/24

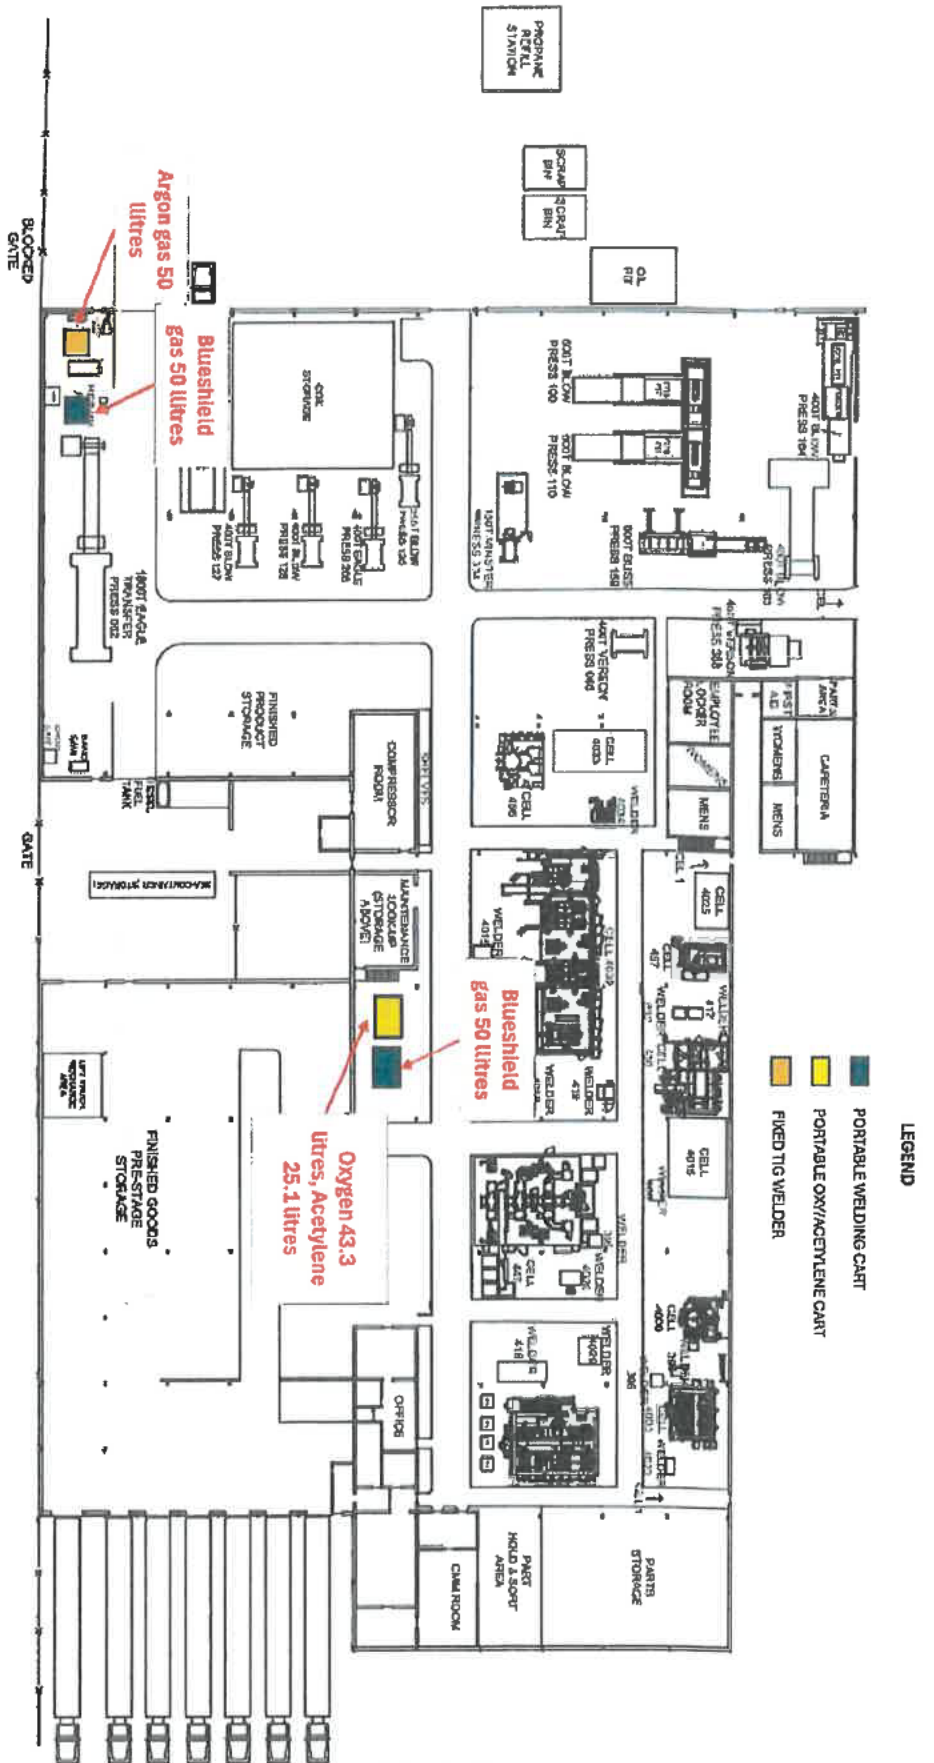

PMP PLANT LAYOUT

